


# Asbestos Management Survey Report

Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER



Undertaken by <b>SWINDON ASBESTOS SURVEYING LTD</b>	
Checked by:	Eddie O Sullivan
Verified/Signature:	
Date of Survey:	18 Nov 2025 to 7 Dec 2025
Date of Report:	18 Dec 2025
<u>Job No:</u>	<u>J012946</u>
Authorising Surveyor:	Jim Hook
Verified/Signature:	
Swindon Asbestos Surveying Ltd, Unit 25, Blackworth Industrial Estate, Highworth, Swindon, Wiltshire, SN6 7NA Tel: 01793 432090 Email: info@swindon-asbestos.co.uk Website: www.swindon-asbestos.co.uk Company No: 5953002	

Swindon Asbestos Surveying Ltd wish to inform their clients that there are under no obligation to use our services for further work related to the recommendations from this report. Swindon Asbestos Surveying Ltd cannot be held responsible if you do not act upon any recommendations detailed in this report.

Swindon Asbestos Surveying Ltd is accredited by the United Kingdom Accreditation Service (UKAS) to undertake surveying for asbestos in premises.



<u>Contents – Management Survey</u>	<u>Pages</u>
Cover Sheet	Page 1
Contents	Page 2
Executive Summary & No Access Areas	Page 3
Introduction	Page 4
Survey Information	Page 5
Material Risk Assessment	Page 8
Algorithm	
Accessibility & Vulnerability Score	
Recommended Actions	
Advised Timescale for Recommended Actions	
Additional Actions for Duty Holder	Page 12
General Safety Recommendations	Page 13
Appendix A: Survey Summary Sheets	
Appendix B: Survey Data Sheets	
Survey Conclusions & Recommendations	
Appendix C: Bulk Analysis Certificate	
Appendix D: Floor Plan	



## Executive Summary

The content of this report relates exclusively to the findings of the Management Survey undertaken in accordance with HSG 264 'Asbestos: The survey guide' and Swindon Asbestos Surveying In House Procedures for Surveying and Sampling of Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER.

### Management Survey

The purpose of the survey is to locate, as far as reasonable practicable, the presence and extent of any suspect asbestos containing materials.

The following asbestos containing materials have been identified, presumed or strongly presumed:  
(Presumptions are avoided when possible during refurbishment and demolition surveys as all areas should be made accessible)

For abbreviation purposes the following may appear in this report in Material type. AIB (Asbestos Insulation Board) and AC (Asbestos Cement).

If there is an (\*) at the end of a sample reference it refers to previous sampling that has taken place prior to this survey date either as part of another survey or bulk sampling exercise. The previous analytical results will added to this report for reference.

Item Number	FI	Building Designation	Location	Asbestos Containing Material	M.A.S	Recommended Action
47	1	Building 01	1.09 - Main Hall	Fireplace (West) - Soffit - Asbestos Cement	5	Further investigation
48	1	Building 01	1.09 - Main Hall	Ceiling - Sprayed coating - Asbestos Insulation/Coating	6	Leave & Manage
49	1	Building 01	1.09 - Main Hall	Main ceiling light medallions - Decorative plaster moulding - Textured Coating	2	Leave & Manage
60	2	Building 01	2.04 - Store	Side of Cylinder - Gasket - Asbestos Textiles/Paper	4	Leave & Manage
68	3	Building 01	Plant Room (Roof)	Within Powermatic heater - Gaskets - Asbestos Textiles/Paper	4	Further investigation
71	3	Building 01	Plant Room (Roof)	Floor - Debris - Asbestos Cement	6	Remove
76	R	Building 01	Attic 01	Redundant flue pipe - Rope seal - Asbestos Textiles/Paper	5	Leave & Manage

The recommended action provided has been determined by the Material Assessment Score and observations made by the surveyor during the survey only. The duty holder must undertake a priority assessment in addition to the findings of this report in order to comply with CAR 2012 Regulation 4.

### No Access Areas

The following table details all areas not accessed during the survey. Although they may be accessible at other times, for the reasons specified they were not available for inspection during the survey.

Item Number	FI	Building Designation	Location	Access Restriction
72	L	Building 01	Lift Shaft	No access to lift shaft. Lift in use.

If there are inaccessible areas in the table above then these areas must be managed presuming that asbestos is present. A further inspection of these areas should be undertaken as soon as practicable to enable an accurate assessment is made.



## Introduction

Swindon Asbestos Surveying Ltd, Unit 25, Blackworth Industrial Estate, Highworth, Swindon, Wiltshire, SN6 7NA has been instructed by Tyson Smith of Chippenham Town Council, Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER to undertake a Management Survey of Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER.

### Management Survey

**Any intrusive works in this property, no matter how minor, will require a further Refurbishment/Demolition Survey (fully intrusive) before any works begin.**

The survey was undertaken on the 18 Nov 2025 to 7 Dec 2025 by Jim Hook.

The property comprises a Stone & brick built Town hall , constructed circa 1834.

### Report Revisions

Issue No	Date of Revision	Reason for Revision
----------	------------------	---------------------

No revisions have been made to this report.

The purpose of the survey is to locate, as far as practicable, the presence and extent of any suspect asbestos containing materials which may be damaged or disturbed during normal occupancy and assess their condition, in order to produce this report and assess whether any remedial action is required.

The information collated in this survey report provides the basis for an asbestos register, risk assessment and management plan which are required in order to comply with CAR 2012. Interpretation of the results and risk assessments are outside the scope of this survey, the duty holder and/or appointed person must carry out their own risk assessment and plan for the management of asbestos containing materials within these areas of the premises.

It is your responsibility as the duty holder and/or appointed person to ensure this information remains current; therefore any changes or remedial actions must be recorded appropriately on the register to enable continued management of asbestos containing materials in your premises.

It is the responsibility of contractors to make their own assessment in respect of pricing removal and or remedial works. The measurements given in this report are estimated therefore attendance to site is recommended.

A priority risk assessment can be provided under separate cover if required but will be outside the scope of our UKAS accreditation.

This report is based on a management survey and is representative of the situation at the time of inspection. Where materials exist at a height and these were beyond which it was reasonably practical to access, the materials have been visually determined and presumptions may have been made. A return visit can be undertaken when safe access is provided by the client. This visit may incur an additional cost.

This report shall not be reproduced except with the expressed approval of Swindon Asbestos Surveying Ltd and the client.



## Survey Information

HSG 264 "Asbestos: The survey guide" defines a management survey as the standard survey. Its purpose is to locate, as far as reasonably practicable, the presence and extent of any suspect asbestos containing materials (ACM) which could be damaged or disturbed during normal occupancy, including foreseeable maintenance, and to assess their condition.

Management surveys will often involve minor intrusive work and some disturbance. The extent will vary between premises and depend on what is reasonably practicable for individual properties. A management survey will include an assessment of the condition of the various ACMs and their ability to release fibres into the air if they are disturbed. This 'material assessment' will give a good guide of the priority for managing ACMs as it will identify the materials which will most readily release airborne fibres.

The survey will usually involve sampling and analysis to confirm the presence or absence of ACMs. However a management survey can also involve presuming the presence of asbestos.

Management surveys are only likely to involve the use of hand tools. Any areas not accessed must be presumed to contain asbestos and will have to be managed on this basis i.e. maintenance or other disturbance work should not be carried out in these areas until further checks are made.

The requested buildings and or areas of the building were thoroughly inspected for materials suspected to contain asbestos and samples were taken by the surveyor where considered necessary, including photographic records. Where one type of material appeared to be extensive, only representative samples were taken. Any sample taken has been analysed by an independent UKAS accredited laboratory.

Where a material is not sampled but is strongly presumed or presumed to contain asbestos it is noted as such and a material assessment is still generated.

A material may be strongly presumed to contain asbestos based on previous laboratory analysis of similar materials, knowledge that the use of asbestos was commonplace during manufacturing or the material has the appearance of asbestos i.e. clearly visible fibres. This is likely to occur in instances where it is physically impracticable at the time of survey to obtain a sample i.e. the material is at height, inside a live appliance or under fixed floor coverings (in the case of floor tiles where they have already been identified at the property).

A material may be presumed to contain asbestos if the surveyor cannot categorically conclude that it does not contain asbestos, therefore it is presumed to be asbestos containing by default. This is likely to occur in instances where it is physically impracticable at the time of survey to obtain a sample or sufficiently visually inspect the material i.e. a firebreak located some distance from the point of access in a ceiling void which is obstructed by ducting and cables.

This report is based upon a non-destructive inspection. All reasonable efforts were made to inspect areas requested by the client to identify the physical presence of materials containing asbestos. Risers, voids and structural ducts were inspected where readily demountable covers existed at access points.



However;

This report may not identify all asbestos containing materials as the extent of material was assessed visually and should be considered as a measure only. Additional sampling is recommended if other asbestos materials are suspected at a later date. Where asbestos materials prevented further access to areas (e.g. above asbestos ceilings), no investigation was carried out and the report was duly notarised.

- | Floor finishes such as fitted or fixed linoleum, laminate flooring and carpets were not taken up unless easily accessed.
- | Inspection covers and underground drainage were not accessed.
- | Examination of substrates to walls, floors and ceilings were not carried out, as the survey is non-intrusive.
- | No appliances or machinery were dismantled for the inspection process.
- | Shuttering inside precast concrete floors was not inspected as the survey is non-intrusive.
- | Under precast concrete floors was not inspected as the survey is non-intrusive.
- | Areas still under normal occupation were not inspected if surveying activities posed a risk to occupants.
- | Live electrical installations were not dismantled for the inspection process.
- | Live gas installations were not dismantled for the inspection process.
- | Areas already deemed as an unsafe structure such as failing floor boards, un-boarded loft areas, flooded areas and confined spaces were not inspected, unless by prior arrangement with appropriate safety precautions in place.
- | Operational equipment and machinery (boilers, heaters etc) were not dismantled for the inspection process.
- | Locked and or sealed areas such as strong rooms and safes etc were not inspected.
- | Hidden areas within the structure of the building such as fully bricked and or concrete sealed voids and risers were not inspected as the survey is non-intrusive.
- | Sealed areas which may contain asbestos materials which have been utilised as packers ad hoc throughout the site were not inspected as the survey is non-intrusive. Such areas will include, but not be limited to roof and or floor joists, internal areas to door and window frames.
- | Internal construction of doors, where damage can be considered to compromise fire resistance and hence the fire safety of the building, were not accessed.
- | When sampling behind door frames, skirting boards etc, and a large number may be present throughout the site, a representative number of items will be inspected and presumed to be consistent in all other cases.
- | Any areas to the exterior of the building where survey damage would be considered to compromise the building's security were not accessed.
- | Below top soil or other surfaces to the exterior of the structure or internally to the sub floor areas were not inspected as the survey is non-intrusive.
- | Areas below or behind existing building fabric which would require part demolition of the structure were not inspected as the survey is non-intrusive. For example large areas of boarded floors which would require complete removal of the entire floor to enable access behind or under each joist.
- | Any area where access is not possible whilst utilising normal survey access equipment (two stage ladders), or a maximum of 3 metres in height was not inspected due to the Health and Safety implications of working at height, unless prior arrangements have been confirmed.
- | Any items stored within the buildings which do not form part of the fabric or structure of the building such as boxes, cupboards and storage crates etc were not inspected.
- | This list is not exhaustive



## Survey planning and procedure

The duty holder's requirements have been established and the type and scope of survey(s) to be undertaken agreed at the initial consultation stage.

Where available, floor plans, previous surveys and pre-existing documentation concerning the structure, construction and details of adaptations have been obtained.

Site specific details have been obtained from the duty holder including safety and security information, permits to work and access arrangements to ensure the survey is completed efficiently, effectively and safely. Where this is not the case and limitations are discovered during the survey they have been recorded appropriately.

A desk top study has been undertaken in order to plan the execution of the survey. Contributing factors including the nature, age and construction of the site have been considered and the survey has been properly resourced.

Any anomalies arising during the survey which impact on the scope of survey have been relayed to the client in a timely manner and resolved as far as practicable. Any further requirements have been identified in the contract review.

The survey was carried out in accordance with our internal Surveying Procedure Quality Manual, Appendix A and the "HSG 264 Asbestos: The survey guide" guidance for the surveying, sampling and assessment of asbestos containing materials.

Swindon Asbestos Surveying Ltd surveyors operate with independence, impartiality and integrity and are sufficiently trained, experienced and authorised in all aspects of the surveying work being undertaken.

Swindon Asbestos Surveying Ltd is accredited by the United Kingdom Accreditation Service (UKAS) to undertake surveying for asbestos in premises.



## Material Assessment Score Algorithm

The four main parameters which determine the potential an asbestos containing material has to release fibres, when subject to a standard disturbance, are shown as per the HSG 264 scoring algorithm below:

Sample variable	Score	Examples of scores
Product Type (including debris)	1	Asbestos-reinforced composites: plastics, resins, mastics, roofing felts, vinyl floor tiles, semi-rigid paints or decorative finishes, asbestos cement.
	2	Asbestos insulation board, millboards, other low-density insulation boards, asbestos textiles, gaskets, ropes and woven textiles, asbestos paper and felt.
	3	Thermal insulation (e.g. Pipe and boiler lagging), sprayed asbestos, loose asbestos, asbestos mattresses and packing.
Extent of damage/deterioration	0	Good condition: no visible damage
	1	Low damage: a few scratches or surface marks, broken edges on boards, tiles etc
	2	Medium damage: significant breakage of materials or several small areas where material has been damaged revealing loose asbestos fibres
	3	High damage: delamination of materials, sprays and thermal insulation. Visible asbestos debris
Surface Treatment	0	Composite materials containing asbestos: reinforced plastics, resins, vinyl tiles and textured coating.
	1	Enclosed sprays and lagging, Asbestos insulation board (with exposed face painted or encapsulated), asbestos cement sheets etc
	2	Unsealed Asbestos insulation board, or encapsulated lagging and sprays
	3	Unsealed lagging and sprays
Asbestos Type	1	Chrysotile
	2	Amphibole asbestos excluding crocidolite
	3	Crocidolite
Total		

The Potential for Fibre Release (P.F.R) rating is defined as;

Materials with assessment scores of 10 or more are regarded as having a high potential to release fibres, if disturbed.

Scores of between 7 and 9 are regarded as having a medium potential to release fibres.

Scores of between 5 and 6 are regarded as having a low potential to release fibres.

Scores of 4 or less have a very low potential to release fibres.



## Accessibility/Vulnerability Score

In addition to the four parameters of the material assessment it is a requirement of an asbestos management survey to record how accessible or vulnerable an ACM is to sustaining damage. An evaluation has been made using the following scoring system:

Accessibility factor	Score	Examples of scores
Inaccessible or Remote	0	soffits, fascia, gas fires, distribution boards, fuse boxes, lift motor machinery, roof sheeting, felts or tiles, gutter linings or flashings, rope seals or putty to windows, covered floor tiles or linoleum, high level rainwater goods, autoclave linings
Occasional disturbance likely	1	sink pads, loft tanks, textured coating to ceilings, ceiling panels, external medium to high level profile sheeting, cladding or slates, gaskets
Easily disturbed, easily accessed	2	window sills, wall panels, textured coating to walls, external low level profile sheeting, cladding or slates and rainwater goods
Routinely disturbed	3	fire doors, exposed floor tiles or linoleum, toilet cisterns, banisters, step nosing, lab bench or propagation worktops, larder shelving, bath panels



## Recommended Actions

Where an asbestos material has been identified or presumed, a recommended action has been allocated to it. This is dependent upon the product type (e.g. spray insulation, asbestos insulating board, floor tiles, asbestos cement sheeting etc.), condition, surface treatment, asbestos type, location, vulnerability to damage and observations made by the surveyor at the time of survey (please note that the sample description, material type and comments/observations are opinions of the surveyor at the time of survey).

The following recommended actions can be allocated to an identified or presumed asbestos material:

### Leave & Manage

The material may be left in situ and warning labels applied at the client's request. Undertake continued regular recorded inspections on the condition of the material as dictated in the asbestos register and management plan.

### Encapsulate/Reseal

The material requires encapsulation (e.g. enclose, seal over, or paint with a proprietary encapsulating material), thereafter the material may be left in situ and warning labels applied at the client's request. The asbestos register and management plan must be updated to record the remedial action undertaken. Undertake continued regular recorded inspections on the condition of the material.

### Remove/Repair

The material requires removal or repair within the legislative requirements of the following:

Health and Safety at Work Act 1974

Management of Health & Safety at work regulations 1999

Control of Asbestos Regulations 2012.

Current HSE Approved Codes of Practice (ACOPS) including L127 and L143

The asbestos register must be updated to record the remedial action undertaken.

If the material is identified as licensed, activities must be undertaken by an approved asbestos removal contractor holding a current HSE licence.

If the material is identified as non-licensed, activities may be undertaken by trained asbestos operatives following the latest ACOPS and HSE Guidance Notes and will fall onto one of the following categories:

1. Non-licensed works.
2. Notifiable non-licensed works which must be notified to the HSE or Local Enforcing Authority prior to works commencing.

### Investigate Further

Where a material is presumed to contain asbestos or areas have not been accessed during the survey, a recommendation for further investigation will be made (e.g. additional access requirements for sampling at height or isolation of live plant etc.). It is imperative that all no accessed areas are recorded on the asbestos register and management plan whilst further investigation is pending.



## Advised Timescale for Recommended Action

An advisory timescale for implementation of the recommended action is provided which is calculated by combining the total material assessment score with the accessibility/vulnerability score and assigned to each asbestos material as follows:

Combined Total	Action Timescale (from date of report)
HIGH (11+)	1 to 3 months – Urgent attention required followed by regular recorded inspection if applicable Once completed the Asbestos Register must be notarised accordingly
MEDIUM (8 – 10)	3 to 6 months – Near term attention required followed by regular recorded inspection if applicable Once completed the Asbestos Register must be notarised accordingly
LOW (6 – 7)	6 months – ACMs will normally only require regular 6 monthly recorded inspections Each inspection should be duly notarised in the Asbestos Register.
VERY LOW (2 – 5)	12 months – ACMs will normally only require regular 12 monthly recorded inspections Each inspection should be duly notarised in the Asbestos Register.

Additional Timescale:–

IMMEDIATE	ACMs, which in the opinion of the surveyor require containment and/or restricted access until either full removal or encapsulation can be undertaken by a licensed asbestos removal contractor (i.e. debris)
-----------	--

Please be advised that this timescale is advisory and does not negate the requirement for a full priority assessment to be generated in order to effectively plan the management of asbestos in your premises.




Additional Actions for the Duty Holder (following completion of the survey)

It is a requirement under the Control of Asbestos Regulations 2012 and Approved Code of Practice L127 The management of asbestos in non-domestic premises (2nd edition 2006), to assess the risk of anyone being exposed to fibres from ACMs.

This assessment should be undertaken by the duty holder and/or the appointed person responsible for managing asbestos within the premises. The HSE define a duty holder as “the person or organisation that has clear responsibility for the maintenance or repair of non-domestic premises through an explicit agreement such as a tenancy agreement or contract”.

The risk of exposure is calculated by combining the total material assessment score provided in this survey with a priority assessment score. The total material assessment score for each identified or presumed asbestos containing material is recorded as follows on the Survey Data Sheets:



Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
1	0	0	1	2	2	4

The duty holder is best placed to undertake the priority assessment as they are equipped with knowledge of occupancy and maintenance activities of the premises. Details of generating the priority assessment are provided in Health & Safety Executive publication HSG227 Managing Asbestos in premises.

The higher the combined material and priority score the greater the risk and therefore the higher the priority for undertaking remedial action. It is this overall risk assessment which forms the basis for the implementation of a management plan for all asbestos materials identified or presumed at the premises. In addition it is also a requirement to ensure that anyone potentially at risk receives information on the location and condition of the asbestos material, so far as it is within the duty holder's control.



## General Safety Recommendations

### Disturbance

Where asbestos materials are known or presumed to exist, it is recommended that no uncontrolled disturbance occurs to the material. In particular, active measures must be taken to avoid all breaking, cutting, drilling, sanding and general abrasion of surfaces.

### Fibre Release

As disturbance of asbestos containing materials may release respirable fibres into the atmosphere, it is recommended that encapsulation; regular maintenance and removal work on notifiable materials is undertaken in accordance with controlled conditions by an approved and licensed asbestos removal contractor holding a current HSE license.

### Remedial Asbestos Works

All removal work or encapsulation should be undertaken in accordance with an approved work method statement, which incorporates all relevant current legislation for asbestos works e.g. Approved Codes of Practice (current issues) together with the Control of Asbestos Regulations (current issue) and The Health and Safety at Work Act.

### Disposal

All asbestos products and non-asbestos products which have become contaminated by asbestos are classified as hazardous waste under the Hazardous Waste Regulations 2005 (England and Wales) and require disposal at licensed sites. Loose asbestos products (pipe insulation, sprayed insulation, broken boards etc) and any asbestos containing waste weighing more than 500kg, during any 12 month period, require a consignment system to control the transportation of the waste from the location of removal to its final disposal destination.

### Air Monitoring

It is recommended that all air monitoring work (i.e. smoke testing, air sampling, fibre counting and visual inspections) is undertaken by an independently appointed UKAS accredited laboratory. It is an HSE requirement that all asbestos work enclosures must be visually inspected and have air clearance certificates issued by the laboratory before they are deemed fit for normal occupation.

### Advice to Third Parties

Duty holders must make known the existence, or suspected existence, of asbestos to any contractor, maintenance worker or any other person who is likely to disturb such materials. They must also provide advice on any appropriate precautions to be taken. The current asbestos register should be made available for perusal by contractors, who sign the register to confirm they understand that there may be asbestos present in their work area and adaptations to their usual working methods may be necessary.

### Labelling

Asbestos materials likely to be disturbed by maintenance or other workers/persons should be clearly labelled (the 'a' logo is recommended). However, it is accepted that it may not be possible to display labels in public areas as doing so may cause undue concern to the public.



## Appendix A: Survey Summary Sheets

Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
1	Surveyed	Building 01	Z	B.01 - Stairwell	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, rendered finish; floor - concrete; ceiling - concrete with rendered finish.															
2	Surveyed	Building 01	Z	B.02 - Store	No asbestos detected	No asbestos detected								0	
Room: Door - timber; walls - stone / block, rendered finish; floor - concrete; ceiling - concrete with rendered finish, exposed steel beam; modern dehumidifier mounted to wall bracket.															
3	Surveyed	Building 01	Z	B.03 - Store	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, rendered finish; floor - concrete; ceiling - concrete with rendered finish, exposed steel beam; modern dehumidifier mounted to wall bracket.															
4	Surveyed	Building 01	Z	B.04	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, rendered finish; floor - concrete; back of stairs - concrete construction..															
5	Surveyed	Building 01	Z	B.05	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, rendered finish; floor - concrete; ceiling stone / concrete with rendered finish.															
6	Surveyed	Building 01	Z	B.06	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, part rendered finish; floor - concrete; ceiling - stone / block with rendered finish; pipe - plastic.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage		Surf Treat – Surface Treatment		App A: Page 1 of 14	
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score		Acc/Vuln – Accessibility/Vulnerability Score			
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					

Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
7	Surveyed	Building 01	Z	B.07	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, part rendered finish; floor - concrete; ceiling - stone / block with rendered finish/ pipe - plastic.															
8	Surveyed	Building 01	Z	B.08	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, part rendered finish; floor - concrete; ceiling - stone / block with rendered finish/ pipe - plastic.															
9	Surveyed	Building 01	Z	B.09	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, part rendered finish; floor - concrete; ceiling - stone / block with rendered finish/ pipe - plastic.															
10	Surveyed	Building 01	Z	B.10	No asbestos detected	No asbestos detected								0	
Room: Walls - stone / block, part rendered finish; floor - concrete; ceiling - stone / block with rendered finish/ pipe - plastic.															
11	CT004811	Building 01	Z	B.11 - Stairwell	Walls	Textured coating	No Asbestos detected	6m <sup>2</sup>						0	
Room: Walls - stone / brick to lower levels with painted textured finish, stone / brick with painted plaster finish to upper levels, block, timber paneled partitioning to upper levels; floor - concrete; back of stairs - lath & plaster with painted plaster skim.															
12	REFER (CT004811)	Building 01	Z	B.12	Walls	Textured coating	No Asbestos detected	28m <sup>2</sup>						0	
Room: Door - timber; walls - stone / brick with painted textured finish, block; floor - concrete; ceiling - plasterboard with plaster skim; modern gas meter mounted to wall bracket; air conditioning unit mounted to metal wall brackets; pipes - unlagged mild steel & copper, copper with foam insulation.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage		Surf Treat – Surface Treatment		App A: Page 2 of 14	
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score		Acc/Vuln – Accessibility/Vulnerability Score			
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					

Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
13	REFER (CT004811)	Building 01	Z	B.13	Walls	Textured coating	No Asbestos detected	28m <sup>2</sup>						0	
Room: Walls - stone / brick with painted textured finish; floor - concrete; ceiling - plasterboard with plaster skim; modern Gardian Systec safe mounted onto concrete blocks.															
14	Surveyed	Building 01	Z	B.14	No asbestos detected	No asbestos detected								0	
Room: Door - timber; walls - stone & block; vinyl damp course to block wall; floor - concrete; ceiling - profiled metal sheet shuttering; pipes - plastic; soil pipe - plastic..															
15	Surveyed	Building 01	Z	B.15	No asbestos detected	No asbestos detected								0	
Room: Walls - stone & block; vinyl damp course to block wall; floor - concrete; ceiling - profiled metal sheet shuttering; pipes - plastic; soil pipe - plastic..															
16	Surveyed	Building 01	Z	B.16	No asbestos detected	No asbestos detected								0	
Room: Walls - stone & block; vinyl damp course to block wall; floor - concrete; ceiling - profiled metal sheet shuttering; pipes - plastic; soil pipe - plastic.															
17	Surveyed	Building 01	Z	B.17	No asbestos detected	No asbestos detected								0	
Room: Walls - stone & block; vinyl damp course to block wall; floor - concrete; ceiling - profiled metal sheet shuttering; redundant section of mild steel pipe; soil pipe - plastic..															
18	Surveyed	Building 01	G	G.01 - Entrance Lobby	No asbestos detected	No asbestos detected								0	
Room: External doors - metal frame double glazed units; walls - low level block with painted plaster skim, stone pillars, metal frame glazed partitioning; floor - concrete, carpet; ceiling - vaulted stone.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage		Surf Treat – Surface Treatment		App A: Page 3 of 14	
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score		Acc/Vuln – Accessibility/Vulnerability Score			
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					

Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
19	Surveyed	Building 01	G	G.02 - Reception	No asbestos detected	No asbestos detected								0	
Room: Walls - stone, part painted plaster finish, plasterboard dry-lining with painted plaster finish, metal framed glazed partitioning; plastic service panels to power cables behind plasterboard dry lining; floor - timber; ceiling - vaulted stone; plasterboard with painted plaster skim; external windows - metal frame to floor level; internal windows to Neeld Hall - timber with stone sills (putty to glazing identified in Neeld Hall report); wall mounted electric heaters.															
20	Surveyed	Building 01	G	G.03 - Lobby Area	No asbestos detected	No asbestos detected								0	
Room: Walls - stone, stone / block with painted plaster finish, metal framed glazed partitioning; floor - timber; ceiling - vaulted stone; plasterboard with painted plaster skim; back of stairs - plasterboard with painted plaster skim; modern alarm system boxes mounted to wall.															
21	Surveyed	Building 01	G	G.04 - Basement Stairs	No asbestos detected	No asbestos detected								0	
Room: Door - timber; plasterboard header panel above timber door frame; walls - brick / stone with rendered finish; floor - concrete; steps - concrete; back of stairs - stone construction.															
22	Surveyed	Building 01	G	G.05 - Cupboard	No asbestos detected	No asbestos detected								0	
Room: Door - timber; lath & plaster header panel above timber door frame; walls - brick / stone with painted rendered finish; floor - concrete; steps - concrete; back of stairs - stone construction.															
23	Surveyed	Building 01	G	G.06 - Lobby	No asbestos detected	No asbestos detected								0	
Room: Walls - stone block with painted finish, stone / block and plasterboard partitioning with painted plaster skim, stone pillars with painted finish; floor - timber; ceiling - vaulted stone with painted finish, plasterboard with painted plaster skim; modern wall mounted Unidare night storage heater.															
24	Surveyed	Building 01	G	G.07 - Lobby	No asbestos detected	No asbestos detected								0	
Room: Walls - stone block, plasterboard partitioning with painted plaster skim; floor - timber; ceiling - plasterboard with painted plaster skim; timber service panels to ceiling void; ceiling above - vaulted stone with painted finish; pipes within ceiling void - copper with foam insulation; galvanised metal extractor fan unit and galvanised metal ducting and plastic soil pipes within ceiling void.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage			Surf Treat – Surface Treatment		App A: Page 4 of 14
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score			Acc/Vuln – Accessibility/Vulnerability Score		
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					



Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
31	Surveyed	Building 01	G	G.14 - Office	No asbestos detected	No asbestos detected								0	
Room: Doors - timber; walls - stone, stone / block with painted plaster finish; floor - concrete, carpet tiles; ceiling - vaulted stone; internal windows - metal framed glazing; wall mounted electric heater.															
32	Surveyed	Building 01	G	G.15 - Office	No asbestos detected	No asbestos detected								0	
Room: Doors - timber; walls - stone & brick, plasterboard partitioning with painted plaster skim; floor - concrete, carpet tiles, raised timber, with carpet tiles; timber steps, carpeted with modern vinyl; ceiling - lath & plaster with painted finish; ornate plaster coving; windows - timber double glazed units; modern wall mounted electric heater; timber boxing to riser near electrical cupboard housing data cables; timber boxing to riser near to window housing unlagged mild steel & copper pipes.															
33	Surveyed	Building 01	G	G.16 - Electrical Cupboard	No asbestos detected	No asbestos detected								0	
Room: Door - timber panelled; walls - stone / brick with painted plaster skim; floor - concrete; soffit - timber; modern Eaton electrical distribution cabinets mounted to wall.															
34	Surveyed	Building 01	G	G.17 - Entrance Lobby	No asbestos detected	No asbestos detected								0	
Room: External doors - semi-glazed timber paneled walls - stone / brick with painted plaster skim, timber paneling to side of stairs; floor - concrete, plywood, carpet; ceiling & back of stairs - lath & plaster with painted finish.															
35	Surveyed	Building 01	G	G.18 - Basement Stairs	No asbestos detected	No asbestos detected								0	
Room: Door - timber paneled; walls - stone / brick with painted plaster skim, timber panel partitioning; steps - concrete construction; back of stairs - lath & plaster with painted finish; wall mounted alarm system boxes.															
36	CT004810	Building 01	G	G.19 - Fire Escape Lobby	Steel beams	Sprayed coating	No Asbestos detected	4.5lm						0	
Room: External doors - timber; walls - block, plasterboard cladding to upper levels to stairs; floor concrete; ceiling - steel support beams with sprayed coating to profiled metal sheeting and plasterboard.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage		Surf Treat – Surface Treatment		Acc/Vuln – Accessibility/Vulnerability Score	
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score				App A: Page 6 of 14	
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					





Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
49	CT004779	Building 01	1	1.09 - Main Hall	Main ceiling light medallions	Decorative plaster moulding	Textured Coating	3no.	Chrysotile	1	0	0	1	2	1
50	CT004780	Building 01	1	1.09 - Main Hall	Light & ventilation medallions	Decorative plaster moulding	No Asbestos detected	6						0	
51	CT004781	Building 01	1	1.09 - Main Hall	Walls	Decorative plaster coving	No Asbestos detected	52lm						0	
52	CT004782	Building 01	1	1.09 - Main Hall	Walls	Decorative plaster moulding	No Asbestos detected	5no.						0	
53	CT004783	Building 01	1	1.09 - Main Hall	Sash windows	Sash cord	No Asbestos detected	6no.						0	
Room: Doors - timber; walls - brick / stone, painted plaster skim with timber paneling to lower levels; decorative plaster moldings above door frames and fire places; decorative plaster coving to top of walls / ceiling; floor - timber; ceiling - lath & plaster with painted textured finish; decorative coving to main chandelier & ventilation ceiling medallions, decorative plaster molding to recessed light and ventilation medallions; windows - timber sash with timber secondary glazed units with timber sills; cast iron fireplaces with stone surrounds and concrete hearths, with cardboard covering to east fireplace chimney opening, and presumed cement sheet soffit panel to west fireplace chimney opening.															
54	REFER (CT004783)	Building 01	1	1.10 - Landing	Sash windows	Sash cord	No Asbestos detected	2no.						0	
Room: Walls - stone & brick with painted plaster skim; floor - timber, carpet; stairs - timber construction with modern vinyl nosing; ceiling and back stairs - lath & plaster with painted finish; plaster coving to ceiling; window - timber, timber sash, timber sills, timber shuttering.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage		Surf Treat – Surface Treatment		App A: Page 9 of 14	
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score		Acc/Vuln – Accessibility/Vulnerability Score			
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					









Client Ref: email			Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER							Survey Date(s):		18 Nov 2025 to 7 Dec 2025			
SAS Job No: 12946			Surveyor(s): Jim Hook							Survey Type:		Management Survey			
No	Sample Ref/ Visual	Building	FL	Area	Position	Element	Material	Qty	Analysis Result	Mat Type	Ext Dam	Surf Treat	Asb Type	Total	Acc/Vuln
79	CT004800	Building 01	R	Attic 03	Ducting joints	Mastic sealant	No Asbestos detected	<1lm						0	
Room: Access panel - timber with MMMF insulation; walls - stone & brick; floor - timber joists, plasterboard, MMMF insulation; inner roof - timber joists, underfelt; pipes - unlagged metal; extractor fans with galvanised metal ducting.															
80	CT004789	Building 01	E	External	Windows (rear of building)	Putty to glazing	No Asbestos detected	80lm						0	
81	REFER (CT004789)	Building 01	E	External	Flat roof area (rear of building)	Debris	No Asbestos detected	2m²						0	
82	CT004790	Building 01	E	External	Windows (front and side of building)	Putty to glazing	No Asbestos detected	60						0	
83	REFER (CT004790)	Building 01	E	External	Roof lantern	Putty to glazing	No Asbestos detected	50lm						0	
Room: Roofing - pitched natural slates with stone parapets; down pipes - metal; walls - stone; windows - timber sash, stone sills; doors - timber, metal frame glazing; flat pitched mineral felt roofing to section of roof linking Town Hall to Neeld Hall with galvanised metal ducting vents protruding through flat roof; galvanised metal ducting with foil faced MMMF insulation; external soil pipes - plastic & metal; air conditioning units mounted to wall brackets with foam lagged copper pipe runs into the Town Hall.															

*External Notes: N/A.							
*Internal Notes: N/A.							
Guidance Notes:		Red – Asbestos Material		Green – Non Asbestos Material		Orange – Presumed Asbestos Material/No Access Area	
		MS – Management Survey		RS – Refurbishment Survey		DS – Demolition Survey	
No – Identification Number	FL – Floor Level	G – Ground Floor	1,2 etc – Denotes floor level	A – Attic	Qty – Quantity of material	E – External	R – Roof Void
Mat Type – Material Type		Ext Dam – Extent Of Damage		Surf Treat – Surface Treatment		App A: Page 14 of 14	
Asb Type – Asbestos Type		Total – Total Material Risk Assessment Score		Acc/Vuln – Accessibility/Vulnerability Score			
AIB – Asbestos Insulation Board		AC. – Asbestos Cement					



## Appendix B: Survey Data Sheets



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 1



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.01 - Stairwell	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 2



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.02 - Store	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 3



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.03 - Store	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 4



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.04	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 5



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.05	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 6



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.06	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 7



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.07	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 8



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.08	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 9



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.09	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 10



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.10	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 11



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004811	Z-Sub Level 1	B.11 - Stairwell	Walls - Textured coating - Textured Coating	6m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 12



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004811)	Z-Sub Level 1	B.12	Walls - Textured coating - Textured Coating	28m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 13



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004811)	Z-Sub Level 1	B.13	Walls - Textured coating - Textured Coating	28m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 14



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.14	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 15



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.15	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 16



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.16	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 17



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Z-Sub Level 1	B.17	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 18



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.01 - Entrance Lobby	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 19



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.02 - Reception	No asbestos detected - No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 20



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.03 - Lobby Area	No asbestos detected - No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 21



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.04 - Basement Stairs	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 22



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.05 - Cupboard	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 23



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.06 - Lobby	No asbestos detected		N/A	0	N/A

Recommended Action:  
-


Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 24

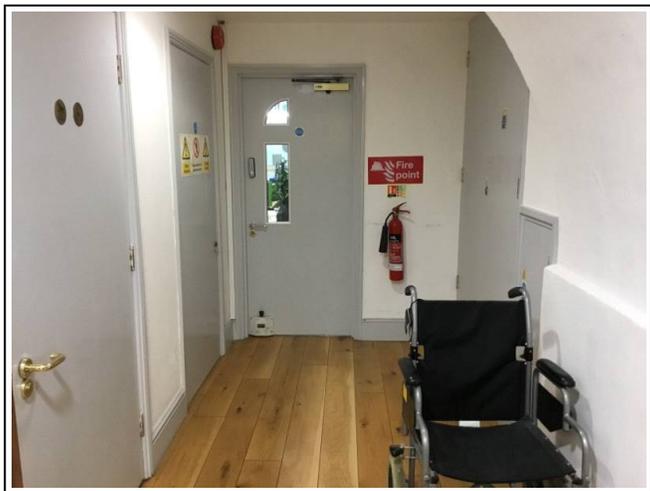

Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.07 - Lobby	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 25



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.08 - Lobby to W/Cs	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 26



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.09 - Unisex W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 27



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.10 - Unisex W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -


Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 28

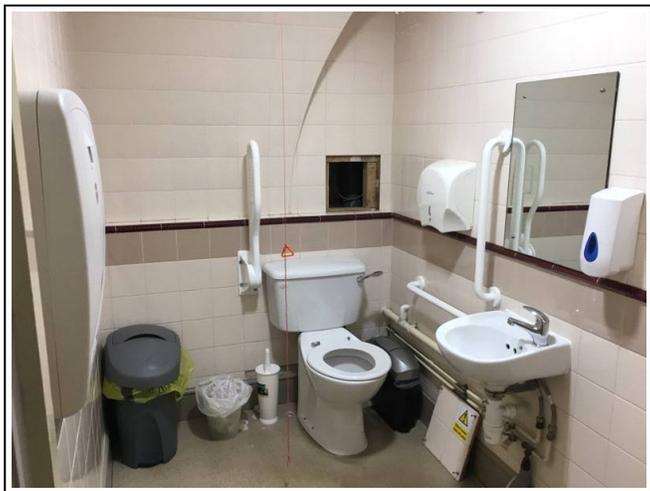

Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.11 - Accessible W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 29



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.12 - Lift Motor Room	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 30



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.13 - Electrical Cupboard	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 31



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.14 - Office	No asbestos detected - No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 32



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.15 - Office	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 33



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.16 - Electrical Cupboard	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 34



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.17 - Entrance Lobby	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 35



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	Ground Floor	G.18 - Basement Stairs	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 36



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004810	Ground Floor	G.19 - Fire Escape Lobby	Steel beams - Sprayed coating - Insulation	4.5lm	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 37



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.01 - Landing	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 38



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.02 - Bar	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 39



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004783)	1st Floor	1.03 - Kitchen	Sash windows - Sash cord - Textiles/Paper	2no.	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 40



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004808	1st Floor	1.03 - Kitchen	Underside of table - Painted coating - Well Bound Material	1no.	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 41



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004809	1st Floor	1.04 - Wash-up	Underside of table - Painted coating - Well Bound Material	1no.	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 42



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.05 - Corridor	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 43



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.06 - Female W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 44



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.07 - Male W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 45



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.08 - Fire Escape	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 46



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004800)	1st Floor	Ceiling Void	Ducting joints - Mastic sealant - Well Bound Material	1Im	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 47



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Presumed	1st Floor	1.09 - Main Hall	Fireplace (West) - Soffit - Asbestos Cement	<0.25m <sup>2</sup>	Crocidolite (or unknown)	5	N

**Recommended Action:**  
 Further investigation

**Advised Timescale for Action/Inspection:**  
 12 Months - ACMs will normally only require regular 12 monthly recorded inspections. Each inspection should be duly notarised in the Asbestos Register.

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
1	0	1	3	5	0	5

Recommendations:

This area must be presumed to contain asbestos materials pending further investigation.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 48



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004778	1st Floor	1.09 - Main Hall	Ceiling - Sprayed coating - Asbestos Insulation/Coating	160m <sup>2</sup>	Chrysotile	6	Y

**Recommended Action:**  
 Leave & Manage

**Advised Timescale for Action/Inspection:**  
 6 Months - ACMs will normally only require regular 6 monthly recorded inspections. Each inspection should be duly notarised in the Asbestos Register.

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
3	0	2	1	6	1	7

Recommendations:

This material may remain in situ and be managed accordingly. Undertake continued regular recorded inspections on the condition of the material as dictated in the asbestos register and management plan. No drilling, cutting or any abrasive actions should take place on this material.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 49



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004779	1st Floor	1.09 - Main Hall	Main ceiling light medallions - Decorative plaster moulding - Textured Coating	3no.	Chrysotile	2	N

**Recommended Action:**  
 Leave & Manage

**Advised Timescale for Action/Inspection:**  
 12 Months - ACMs will normally only require regular 12 monthly recorded inspections. Each inspection should be duly notarised in the Asbestos Register.

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
1	0	0	1	2	1	3

Recommendations:

This material may remain in situ and be managed accordingly. Undertake continued regular recorded inspections on the condition of the material as dictated in the asbestos register and management plan. No drilling, cutting or any abrasive actions should take place on this material.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 50



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004780	1st Floor	1.09 - Main Hall	Light & ventilation medallions - Decorative plaster moulding - Textured Coating	6	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 51



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004781	1st Floor	1.09 - Main Hall	Walls - Decorative plaster coving - Textured Coating	52lm	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 52



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004782	1st Floor	1.09 - Main Hall	Walls - Decorative plaster moulding - Textured Coating	5no.	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 53



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004783	1st Floor	1.09 - Main Hall	Sash windows - Sash cord - Textiles/Paper	6no.	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 54



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004783)	1st Floor	1.10 - Landing	Sash windows - Sash cord - Textiles/Paper	2no.	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 55



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.11 - Office (Cheif Executive)	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 56



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	1st Floor	1.12 - Office (Mayors Parlor)	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 57



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004783)	2nd Floor	2.01 - Landing	Sash windows - Sash cord - Textiles/Paper	2no.	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 58



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004783)	2nd Floor	2.02 - Office (Finance)	Sash windows - Sash cord - Textiles/Paper	2no.	NADIS	0	N/A

Recommended Action:  
 -


Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 59

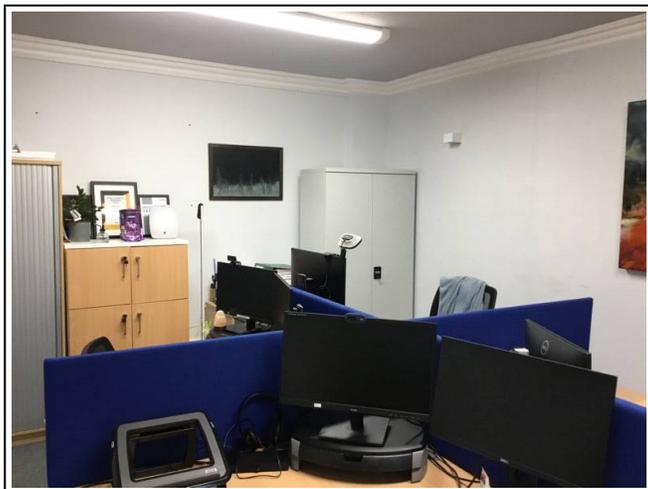

Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	2nd Floor	2.03 - Office (Corporate Services)	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 60



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004807	2nd Floor	2.04 - Store	Side of Cylinder - Gasket - Asbestos Textiles/Paper	2no.	Chrysotile	4	N

**Recommended Action:**  
 Leave & Manage

**Advised Timescale for Action/Inspection:**  
 12 Months - ACMs will normally only require regular 12 monthly recorded inspections. Each inspection should be duly notarised in the Asbestos Register.


Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
2	0	1	1	4	1	5

Recommendations:

This material may remain in situ and be managed accordingly. Undertake continued regular recorded inspections on the condition of the material as dictated in the asbestos register and management plan. No drilling, cutting or any abrasive actions should take place on this material.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 61

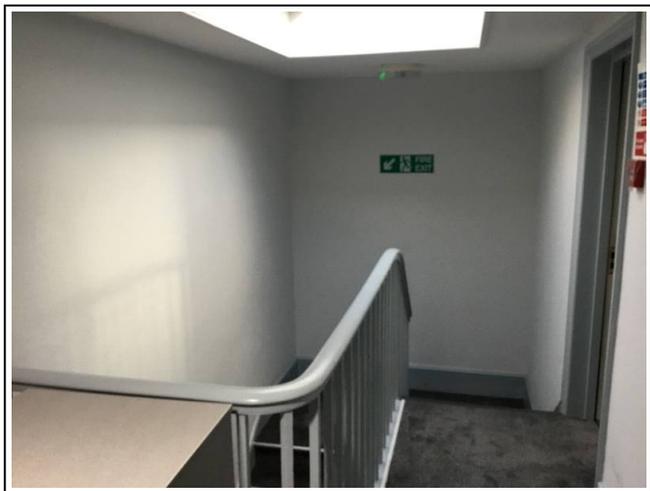

Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	3rd Floor	3.01 - Landing	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 62



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	3rd Floor	3.02 - Office (Democratic Services)	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -


Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 63

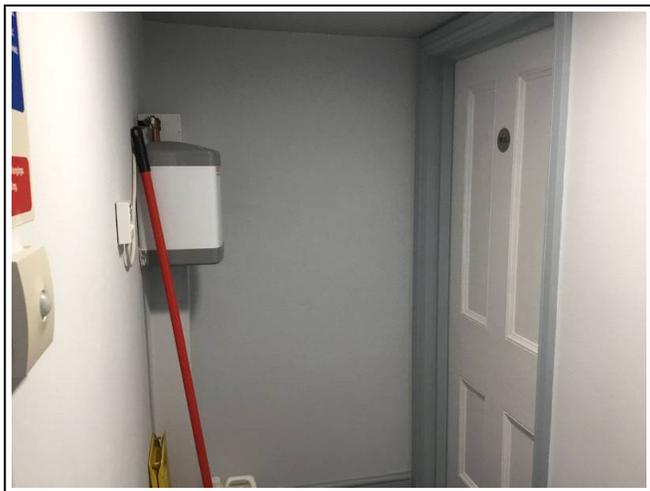

Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	3rd Floor	3.03 - Lobby to W/Cs	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 64



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	3rd Floor	3.04 - W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 65



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	3rd Floor	3.05 - W/C	No asbestos detected		N/A	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 66



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004799	3rd Floor	3.06 - Kitchen	Underside of sink - Sink pad - Well Bound Material	1no.	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 67



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Surveyed	3rd Floor	3.07 - Roof Access	No asbestos detected		N/A	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 68



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
Presumed	3rd Floor	Plant Room (Roof)	Within Powermatic heater - Gaskets - Asbestos Textiles/Paper	1no.	Chrysotile	4	N

**Recommended Action:**  
 Further investigation

**Advised Timescale for Action/Inspection:**  
 12 Months - ACMs will normally only require regular 12 monthly recorded inspections. Each inspection should be duly notarised in the Asbestos Register.

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
2	0	1	1	4	1	5

**Recommendations:**

This area must be presumed to contain asbestos materials pending further investigation.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 69



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004805	3rd Floor	Plant Room (Roof)	Walls - Panelling - Insulating Board	5m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 70



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004805)	3rd Floor	Plant Room (Roof)	Ceiling - Paneling - Insulating Board	6m <sup>2</sup>	NADIS	0	N/A

Recommended Action:

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 71



Sample Ref	Fl	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004806	3rd Floor	Plant Room (Roof)	Floor - Debris - Asbestos Cement	<1m <sup>2</sup>	Chrysotile	6	N

**Recommended Action:**  
 Remove

**Advised Timescale for Action/Inspection:**  
 3-6 Months - Near term attention required followed by regular recorded inspection if applicable. Once completed the Asbestos Register must be notarised accordingly.

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
1	3	1	1	6	2	8

Recommendations:

This material requires removal within current legislative requirements.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 72



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
No Access	Lift Shaft	Lift Shaft	Inaccessible		No Access	0	

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
				0		

Recommendations:

This area must be presumed to contain asbestos materials pending further investigation.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 73



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004801	Roof Void	Attic 01	Ducting joints - Mastic sealant (grey) - Well Bound Material	6lm	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 74



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004802	Roof Void	Attic 01	Ducting joints - Mastic sealant (dark green) - Well Bound Material	12lm	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 75



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004803	Roof Void	Attic 01	Ducting joints - Mastic sealant (dark brown) - Well Bound Material	6lm	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 76



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004804	Roof Void	Attic 01	Redundant flue pipe - Rope seal - Asbestos Textiles/Paper	1no.	Chrysotile	5	N

**Recommended Action:**  
 Leave & Manage

**Advised Timescale for Action/Inspection:**  
 12 Months - ACMs will normally only require regular 12 monthly recorded inspections. Each inspection should be duly notarised in the Asbestos Register.

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
2	0	2	1	5	0	5

**Recommendations:**

This material may remain in situ and be managed accordingly. Undertake continued regular recorded inspections on the condition of the material as dictated in the asbestos register and management plan. No drilling, cutting or any abrasive actions should take place on this material.



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 77



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004798	Roof Void	Attic 02	Inner roof - Underfelt - Well Bound Material	14m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
 -


Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 78

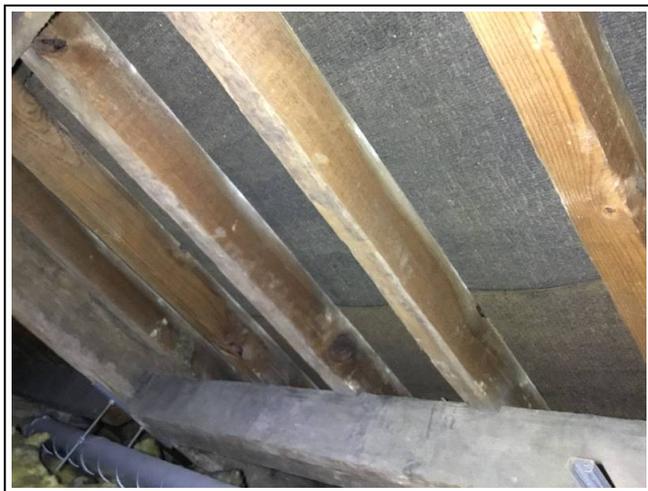

Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004798)	Roof Void	Attic 03	Inner roof - Underfelt - Well Bound Material	14m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 79



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004800	Roof Void	Attic 03	Ducting joints - Mastic sealant - Well Bound Material	<1m	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 80



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004789	External	External	Windows (rear of building) - Putty to glazing - Well Bound Material	80lm	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 81



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004789)	External	External	Flat roof area (rear of building) - Debris - Well Bound Material	2m <sup>2</sup>	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 82



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
CT004790	External	External	Windows (front and side of building) - Putty to glazing - Well Bound Material	60	NADIS	0	N/A

Recommended Action:  
 -

Advised Timescale for Action/Inspection:  
 N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



Survey Data Sheet: Conclusions & Recommendations  
 Site Location: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER  
 Building Designation: Building 01  
 Unique item Number: 83



Sample Ref	FI	Location	Description	Qty	Analysis Result	Total M.A.S	Licensed Material Y/N
REFER (CT004790)	External	External	Roof lantern - Putty to glazing - Well Bound Material	50lm	NADIS	0	N/A

Recommended Action:  
-

Advised Timescale for Action/Inspection:  
N/A

Product Type	Extent of Damage	Surface Treatment	Asbestos Type	Total M.A.S	Accessibility/ Vulnerability	Combined Total for Advised Timescale
0	0	0	0	0	0	

Recommendations:  
 No asbestos detected in sample



## Appendix C: Bulk Analysis Certificate

## CERTIFICATE FOR THE IDENTIFICATION OF ASBESTOS FIBRES

<b>Client Name:</b>	Swindon Asbestos Surveying Ltd		
<b>Client Address:</b>	Unit 25 Blackworth Industrial Estate Highworth Swindon Wiltshire, SN6 7NA		
<b>Site Address:</b>	Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER		
<b>UPRN/Site Ref:</b>	J12946	<b>Date of Analysis:</b>	12 Dec 2025
<b>Attention of:</b>	Jayne O'Sullivan	<b>Analysis Report No:</b>	J069891
<b>Surveyor:</b>	N/A	<b>Report Issue No:</b>	1
<b>Date Samples Taken:</b>	18 Nov 2025	<b>Report Date:</b>	12 Dec 2025
<b>No. of Samples:</b>	22	<b>Analysed By:</b>	Richard Gray Viola Goral
<b>Obtained:</b>	Delivered		
<b>Date Samples Recd:</b>	9 Dec 2025		

**KEY**

**METHOD**

N.A.D.I.S = NO ASBESTOS DETECTED IN SAMPLE
CROCIDOLITE = Typically Known as Blue Asbestos (Amphibole Group)
AMOSITE = Typically Known as Brown Asbestos (Amphibole Group)
CHRYSOTILE = Typically Known as White Asbestos (Serpentine Group)
ANTHOPHYLLITE = Asbestos (Amphibole Group)
ACTINOLITE = Asbestos (Amphibole Group)
TREMOLITE = Asbestos (Amphibole Group)

Samples of material thought to contain asbestos are examined in the analytical laboratory, they are examined by eye, followed by more detailed examination using a low powered stereo microscope (X 8 to X 40 magnification), one or more representative sub samples may be prepared mechanically and/or chemically for further examination. Fibres observed in the course of these examinations are categorised tentatively on the basis of morphology and certain physical properties. Each fibre type recognised is sampled by selecting a few fibres or bundles, these are mounted in a refractive index (RI) liquid chosen to match the most likely asbestos type. The fibres are then positively identified as one of the six regulated asbestos types on the basis of their detailed optical properties using polarised light microscopy (PLM) with X 80 upwards magnification, as appropriate to the type of sample. This test report shall not be reproduced, except in full. Without the written approval of AC & MS Ltd.

Samples of material, referenced below, have been examined to determine the presence of asbestos fibres, using AC&MS Ltd "in house" method of transmitted/polarised light microscopy and centre stop dispersion staining, Procedure 05; based on HSE's HSG 248. The sample type described within this bulk certificate is only an opinion & interpretation of AC&MS Ltd, & is outside the scope of our UKAS testing accreditation. If samples have been delivered the site address and actual sample location or sample type is as given by the client at the time of delivery, AC&MS Ltd are not responsible for the accuracy or competence of the sampling by third parties. Under these circumstances AC&MS Ltd cannot be held responsible for the interpretation of the results shown. AC&MS Ltd only takes responsibility of information reported when a staff member of AC&MS Ltd takes the sample(s), using AC&MS Ltd "in house" method of bulk sampling, Procedure 001 based on HSE's HSG 264

Sample Ref	Item Ref	Sample Location / Sample Type	Fibre Type Detected
BS074471	CT4778	1.09 - Main Hall – Sprayed Coatings	CHRYSOTILE
BS074472	CT4779	1.09 - Main Hall – Decorative Plaster Moulding	CHRYSOTILE
BS074473	CT4780	1.09 - Main Hall – Decorative Plaster Moulding	N.A.D.I.S
BS074474	CT4781	1.09 - Main Hall – Decorative Plaster Covering	N.A.D.I.S
BS074475	CT4782	1.09 - Main Hall – Decorative Plaster Moulding	N.A.D.I.S
BS074476	CT4783	1.09 - Main Hall – Sash Cord	N.A.D.I.S
BS074477	CT4789	External – Putty to Glazing	N.A.D.I.S



Registered Office: Unit 13, International Business Park, Charfleets Road, Canvey Island, Essex, SS8 0SG. Registered in England & Wales.  
Company Registration Number 4664684

THIS TEST REPORT SHALL NOT BE REPRODUCED, EXCEPT IN FULL. WITHOUT THE WRITTEN APPROVAL OF AC & MS LTD.

## CERTIFICATE FOR THE IDENTIFICATION OF ASBESTOS FIBRES

<b>Client Name:</b>	Swindon Asbestos Surveying Ltd		
<b>Client Address:</b>	Unit 25 Blackworth Industrial Estate Highworth Swindon Wiltshire, SN6 7NA		
<b>Site Address:</b>	Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER		
<b>UPRN/Site Ref:</b>	J12946	<b>Date of Analysis:</b>	12 Dec 2025
<b>Attention of:</b>	Jayne O'Sullivan	<b>Analysis Report No:</b>	J069891
<b>Surveyor:</b>	N/A	<b>Report Issue No:</b>	1
<b>Date Samples Taken:</b>	18 Nov 2025	<b>Report Date:</b>	12 Dec 2025
<b>No. of Samples:</b>	22	<b>Analysed By:</b>	Richard Gray Viola Goral
<b>Obtained:</b>	Delivered		
<b>Date Samples Recd:</b>	9 Dec 2025		

**KEY**

**METHOD**

N.A.D.I.S = NO ASBESTOS DETECTED IN SAMPLE
CROCIDOLITE = Typically Known as Blue Asbestos (Amphibole Group)
AMOSITE = Typically Known as Brown Asbestos (Amphibole Group)
CHRYSOTILE = Typically Known as White Asbestos (Serpentine Group)
ANTHOPHYLLITE = Asbestos (Amphibole Group)
ACTINOLITE = Asbestos (Amphibole Group)
TREMOLITE = Asbestos (Amphibole Group)

Samples of material thought to contain asbestos are examined in the analytical laboratory, they are examined by eye, followed by more detailed examination using a low powered stereo microscope (X 8 to X 40 magnification), one or more representative sub samples may be prepared mechanically and/or chemically for further examination. Fibres observed in the course of these examinations are categorised tentatively on the basis of morphology and certain physical properties. Each fibre type recognised is sampled by selecting a few fibres or bundles, these are mounted in a refractive index (RI) liquid chosen to match the most likely asbestos type. The fibres are then positively identified as one of the six regulated asbestos types on the basis of their detailed optical properties using polarised light microscopy (PLM) with X 80 upwards magnification, as appropriate to the type of sample. This test report shall not be reproduced, except in full. Without the written approval of AC & MS Ltd.

Samples of material, referenced below, have been examined to determine the presence of asbestos fibres, using AC&MS Ltd "in house" method of transmitted/polarised light microscopy and centre stop dispersion staining, Procedure 05; based on HSE's HSG 248. The sample type described within this bulk certificate is only an opinion & interpretation of AC&MS Ltd, & is outside the scope of our UKAS testing accreditation. If samples have been delivered the site address and actual sample location or sample type is as given by the client at the time of delivery, AC&MS Ltd are not responsible for the accuracy or competence of the sampling by third parties. Under these circumstances AC&MS Ltd cannot be held responsible for the interpretation of the results shown. AC&MS Ltd only takes responsibility of information reported when a staff member of AC&MS Ltd takes the sample(s), using AC&MS Ltd "in house" method of bulk sampling, Procedure 001 based on HSE's HSG 264

Sample Ref	Item Ref	Sample Location / Sample Type	Fibre Type Detected
BS074478	CT4790	External – Putty to Glazing	N.A.D.I.S
BS074479	CT4798	Attic 02 – Underfelt	N.A.D.I.S
BS074480	CT4799	3.06 - Kitchen – Sink Pad	N.A.D.I.S
BS074481	CT4800	Attic – Mastic Sealant	N.A.D.I.S
BS074482	CT4801	Attic 01 – Mastic Sealant (Grey)	N.A.D.I.S
BS074483	CT4802	Attic 01 – Mastic Sealant (Dark Green)	N.A.D.I.S
BS074484	CT4803	Attic 01 – Mastic Sealant (Dark Brown)	N.A.D.I.S



Registered Office: Unit 13, International Business Park, Charfleets Road, Canvey Island, Essex, SS8 0SG. Registered in England & Wales.  
 Company Registration Number 4664684

THIS TEST REPORT SHALL NOT BE REPRODUCED, EXCEPT IN FULL. WITHOUT THE WRITTEN APPROVAL OF AC & MS LTD.

## CERTIFICATE FOR THE IDENTIFICATION OF ASBESTOS FIBRES

<b>Client Name:</b>	Swindon Asbestos Surveying Ltd		
<b>Client Address:</b>	Unit 25 Blackworth Industrial Estate Highworth Swindon Wiltshire, SN6 7NA		
<b>Site Address:</b>	Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER		
<b>UPRN/Site Ref:</b>	J12946	<b>Date of Analysis:</b>	12 Dec 2025
<b>Attention of:</b>	Jayne O'Sullivan	<b>Analysis Report No:</b>	J069891
<b>Surveyor:</b>	N/A	<b>Report Issue No:</b>	1
<b>Date Samples Taken:</b>	18 Nov 2025	<b>Report Date:</b>	12 Dec 2025
<b>No. of Samples:</b>	22	<b>Analysed By:</b>	Richard Gray Viola Goral
<b>Obtained:</b>	Delivered		
<b>Date Samples Recd:</b>	9 Dec 2025		

KEY	METHOD
N.A.D.I.S = NO ASBESTOS DETECTED IN SAMPLE	Samples of material thought to contain asbestos are examined in the analytical laboratory, they are examined by eye, followed by more detailed examination using a low powered stereo microscope (X 8 to X 40 magnification), one or more representative sub samples may be prepared mechanically and/or chemically for further examination. Fibres observed in the course of these examinations are categorised tentatively on the basis of morphology and certain physical properties. Each fibre type recognised is sampled by selecting a few fibres or bundles, these are mounted in a refractive index (RI) liquid chosen to match the most likely asbestos type. The fibres are then positively identified as one of the six regulated asbestos types on the basis of their detailed optical properties using polarised light microscopy (PLM) with X 80 upwards magnification, as appropriate to the type of sample. This test report shall not be reproduced, except in full. Without the written approval of AC & MS Ltd.
CROCIDOLITE = Typically Known as Blue Asbestos (Amphibole Group)	
AMOSITE = Typically Known as Brown Asbestos (Amphibole Group)	
CHRYSOTILE = Typically Known as White Asbestos (Serpentine Group)	
ANTHOPHYLLITE = Asbestos (Amphibole Group)	
ACTINOLITE = Asbestos (Amphibole Group)	
TREMOLITE = Asbestos (Amphibole Group)	

Samples of material, referenced below, have been examined to determine the presence of asbestos fibres, using AC&MS Ltd "in house" method of transmitted/polarised light microscopy and centre stop dispersion staining, Procedure 05; based on HSE's HSG 248. The sample type described within this bulk certificate is only an opinion & interpretation of AC&MS Ltd, & is outside the scope of our UKAS testing accreditation. If samples have been delivered the site address and actual sample location or sample type is as given by the client at the time of delivery, AC&MS Ltd are not responsible for the accuracy or competence of the sampling by third parties. Under these circumstances AC&MS Ltd cannot be held responsible for the interpretation of the results shown. AC&MS Ltd only takes responsibility of information reported when a staff member of AC&MS Ltd takes the sample(s), using AC&MS Ltd "in house" method of bulk sampling, Procedure 001 based on HSE's HSG 264

Sample Ref	Item Ref	Sample Location / Sample Type	Fibre Type Detected
BS074485	CT4804	Attic 01 – Rope Seal	CHRYSOTILE
BS074486	CT4805	Plant Room (Roof) – Panelling	N.A.D.I.S
BS074487	CT4806	Plant Room (Roof) – Debris	CHRYSOTILE
BS074488	CT4807	2.04 - Store – Gasket	CHRYSOTILE
BS074489	CT4808	1.03 - Kitchen – Painted Coating	N.A.D.I.S
BS074490	CT4809	1.04 - Wash-Up – Painted Coating	N.A.D.I.S
BS074491	CT4810	G.19 - Fire Exit Lobby – Sprayed Coating	N.A.D.I.S



Registered Office: Unit 13, International Business Park, Charfleets Road, Canvey Island, Essex, SS8 0SG. Registered in England & Wales.  
 Company Registration Number 4664684

THIS TEST REPORT SHALL NOT BE REPRODUCED, EXCEPT IN FULL. WITHOUT THE WRITTEN APPROVAL OF AC & MS LTD.

## CERTIFICATE FOR THE IDENTIFICATION OF ASBESTOS FIBRES

<b>Client Name:</b>	Swindon Asbestos Surveying Ltd		
<b>Client Address:</b>	Unit 25 Blackworth Industrial Estate Highworth Swindon Wiltshire, SN6 7NA		
<b>Site Address:</b>	Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER		
<b>UPRN/Site Ref:</b>	J12946	<b>Date of Analysis:</b>	12 Dec 2025
<b>Attention of:</b>	Jayne O'Sullivan	<b>Analysis Report No:</b>	J069891
<b>Surveyor:</b>	N/A	<b>Report Issue No:</b>	1
<b>Date Samples Taken:</b>	18 Nov 2025	<b>Report Date:</b>	12 Dec 2025
<b>No. of Samples:</b>	22	<b>Analysed By:</b>	Richard Gray Viola Goral
<b>Obtained:</b>	Delivered		
<b>Date Samples Recd:</b>	9 Dec 2025		

**KEY**

**METHOD**

N.A.D.I.S = NO ASBESTOS DETECTED IN SAMPLE
CROCIDOLITE = Typically Known as Blue Asbestos (Amphibole Group)
AMOSITE = Typically Known as Brown Asbestos (Amphibole Group)
CHRYSOTILE = Typically Known as White Asbestos (Serpentine Group)
ANTHOPHYLLITE = Asbestos (Amphibole Group)
ACTINOLITE = Asbestos (Amphibole Group)
TREMOLITE = Asbestos (Amphibole Group)

Samples of material thought to contain asbestos are examined in the analytical laboratory, they are examined by eye, followed by more detailed examination using a low powered stereo microscope (X 8 to X 40 magnification), one or more representative sub samples may be prepared mechanically and/or chemically for further examination. Fibres observed in the course of these examinations are categorised tentatively on the basis of morphology and certain physical properties. Each fibre type recognised is sampled by selecting a few fibres or bundles, these are mounted in a refractive index (RI) liquid chosen to match the most likely asbestos type. The fibres are then positively identified as one of the six regulated asbestos types on the basis of their detailed optical properties using polarised light microscopy (PLM) with X 80 upwards magnification, as appropriate to the type of sample. This test report shall not be reproduced, except in full. Without the written approval of AC & MS Ltd.

Samples of material, referenced below, have been examined to determine the presence of asbestos fibres, using AC&MS Ltd "in house" method of transmitted/polarised light microscopy and centre stop dispersion staining, Procedure 05; based on HSE's HSG 248. The sample type described within this bulk certificate is only an opinion & interpretation of AC&MS Ltd, & is outside the scope of our UKAS testing accreditation. If samples have been delivered the site address and actual sample location or sample type is as given by the client at the time of delivery, AC&MS Ltd are not responsible for the accuracy or competence of the sampling by third parties. Under these circumstances AC&MS Ltd cannot be held responsible for the interpretation of the results shown. AC&MS Ltd only takes responsibility of information reported when a staff member of AC&MS Ltd takes the sample(s), using AC&MS Ltd "in house" method of bulk sampling, Procedure 001 based on HSE's HSG 264

Sample Ref	Item Ref	Sample Location / Sample Type	Fibre Type Detected
BS074492	CT4811	B.11 - Basement Stairwell – Textured Coating	N.A.D.I.S

All samples will be retained in the laboratory for a minimum of six months. Test certificates will be retained for a minimum of seven years.

<b>This Certificate was typed by:</b>	Richard Gray Viola Goral		
<b>Authorised Signatory:</b>		<b>Print name:</b>	Richard Gray Viola Goral
<b>Supplementary Report Statement</b>	N/A		



Registered Office: Unit 13, International Business Park, Charfleets Road, Canvey Island, Essex, SS8 0SG. Registered in England & Wales.  
Company Registration Number 4664684

THIS TEST REPORT SHALL NOT BE REPRODUCED, EXCEPT IN FULL. WITHOUT THE WRITTEN APPROVAL OF AC & MS LTD.




## Appendix D: Floor Plan

# FLOOR PLAN

ADDRESS: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

JOB NO: J12946    DATE: 18.11.25 to 07.12.25    SURVEY TYPE: Management Survey

## BASEMENT

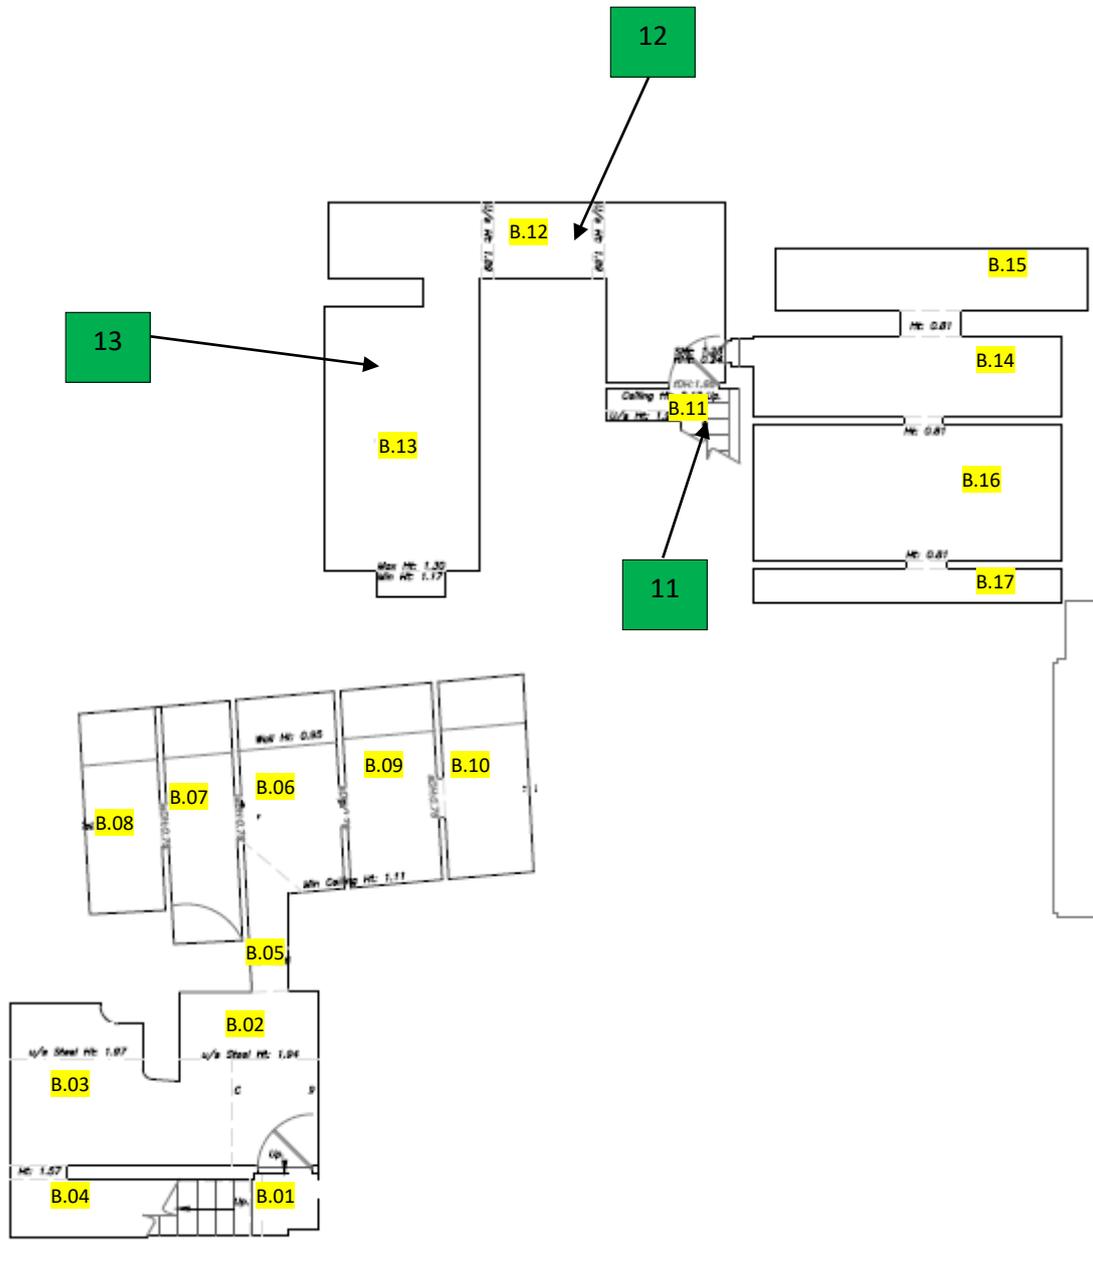

### GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)

ILLUSTRATION ONLY – NOT TO SCALE


F74 Issue 5 21.02.2024

# FLOOR PLAN

ADDRESS: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

JOB NO: J12946    DATE: 18.11.25 to 07.12.25    SURVEY TYPE: Management Survey

## GROUND FLOOR

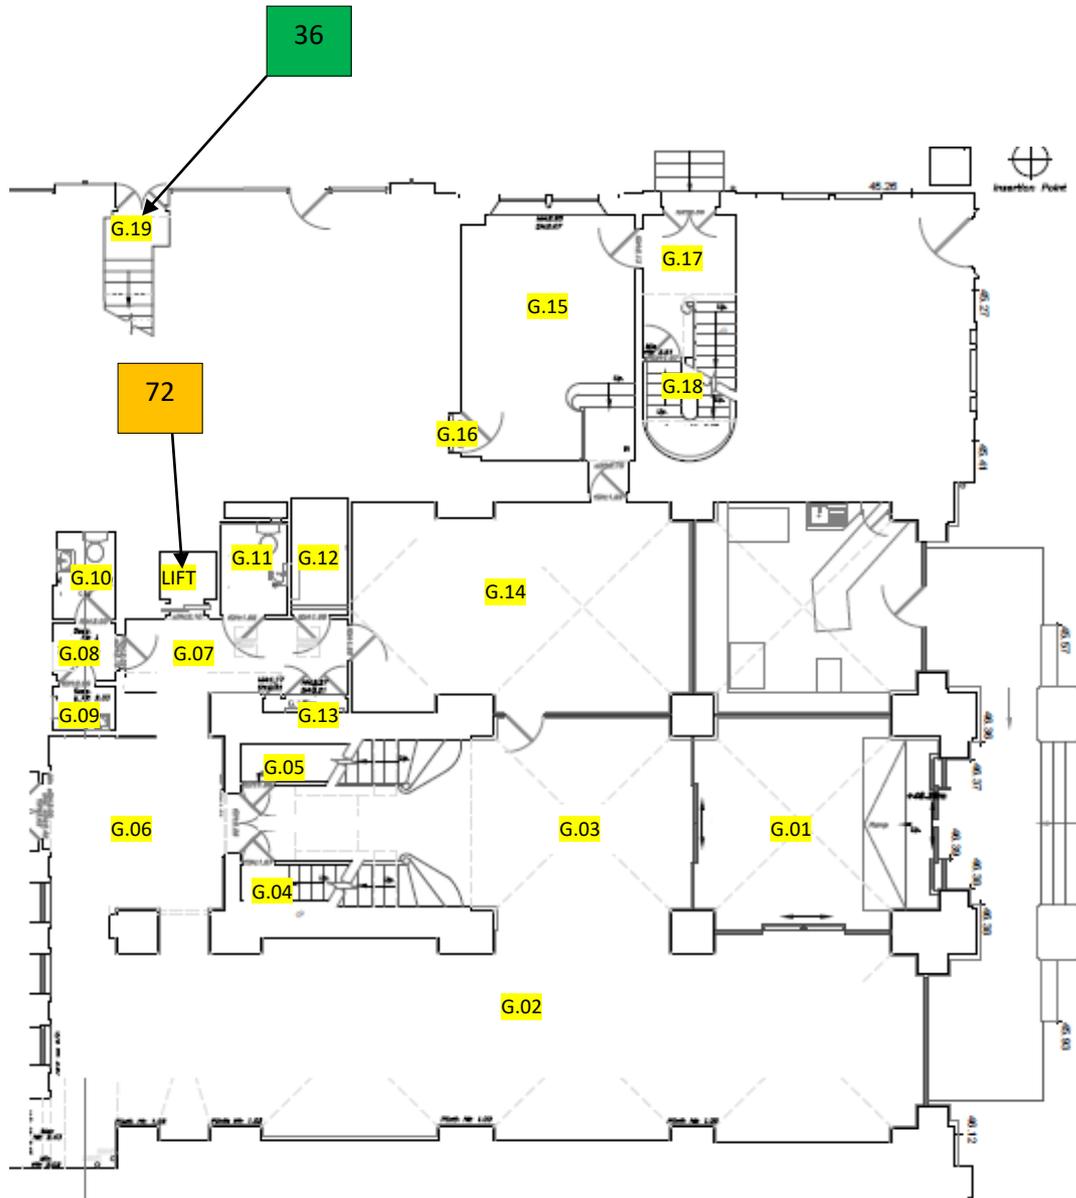

### GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)

ILLUSTRATION ONLY – NOT TO SCALE


F74 Issue 5 21.02.2024

# FLOOR PLAN

ADDRESS: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

JOB NO: J12946    DATE: 18.11.25 to 07.12.25    SURVEY TYPE: Management Survey

## FIRST FLOOR

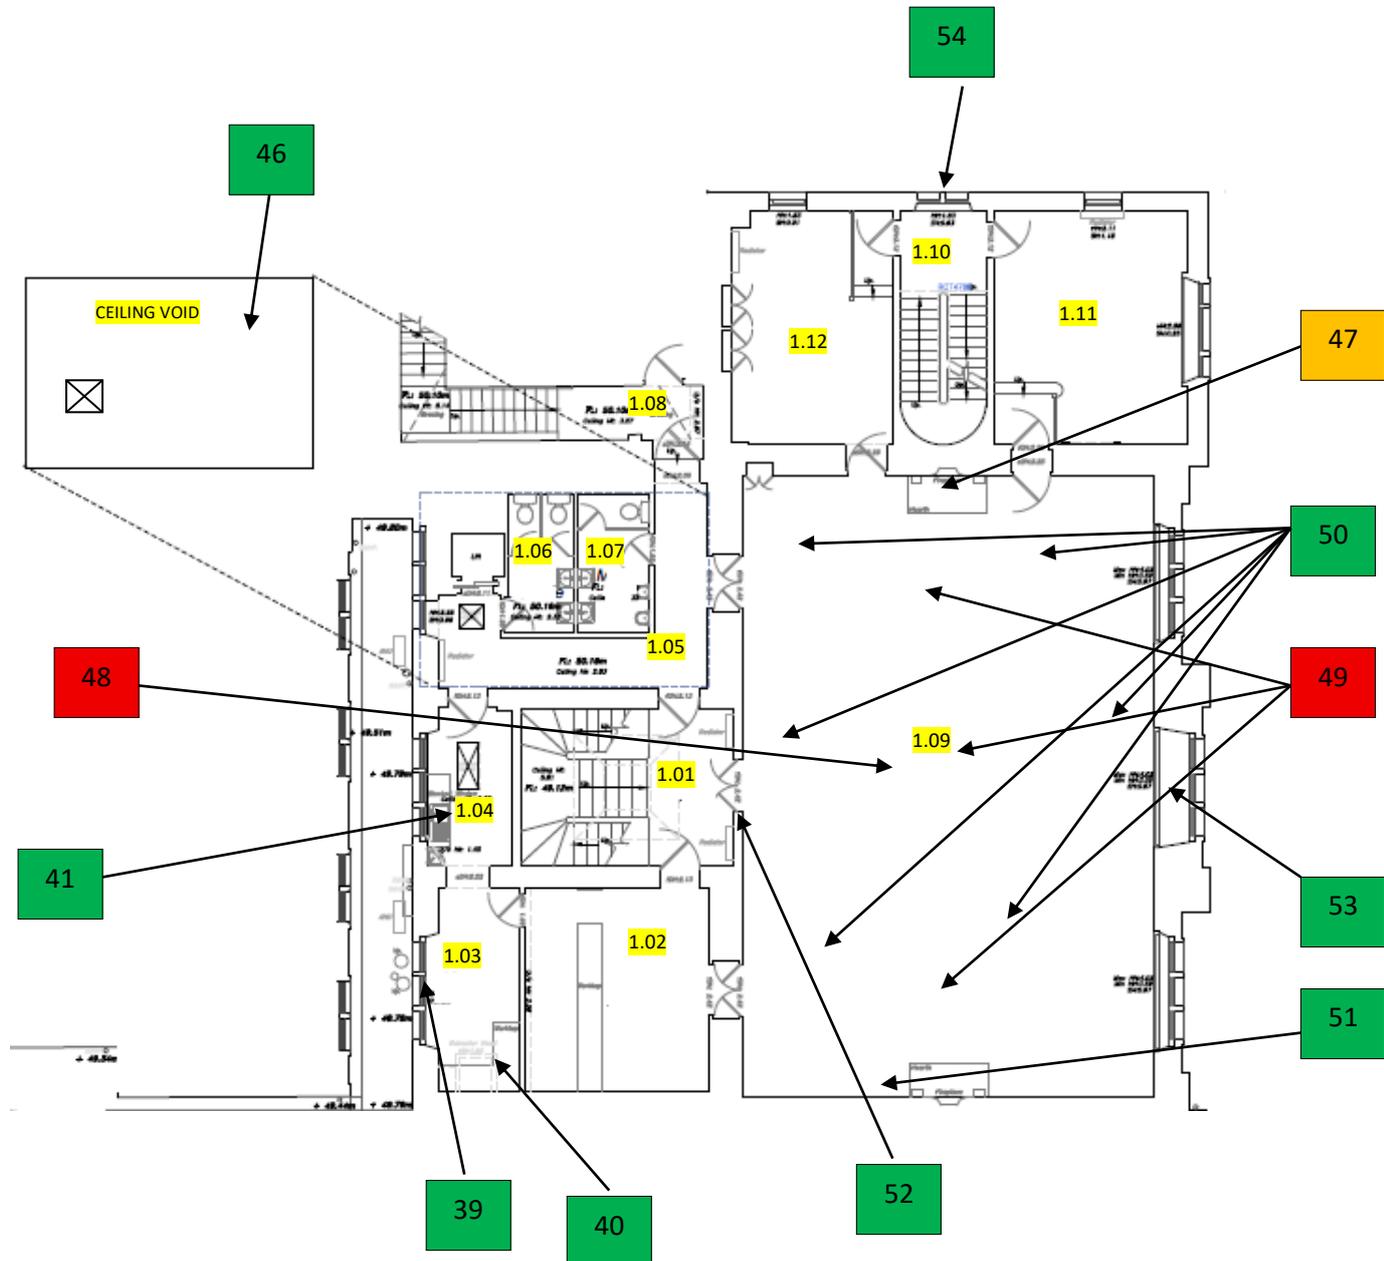

### GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)

ILLUSTRATION ONLY – NOT TO SCALE


F74 Issue 5 21.02.2024

## FLOOR PLAN

**ADDRESS:** Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

**JOB NO:** J12946    **DATE:** 18.11.25 to 07.12.25    **SURVEY TYPE:** Management Survey

### SECOND FLOOR

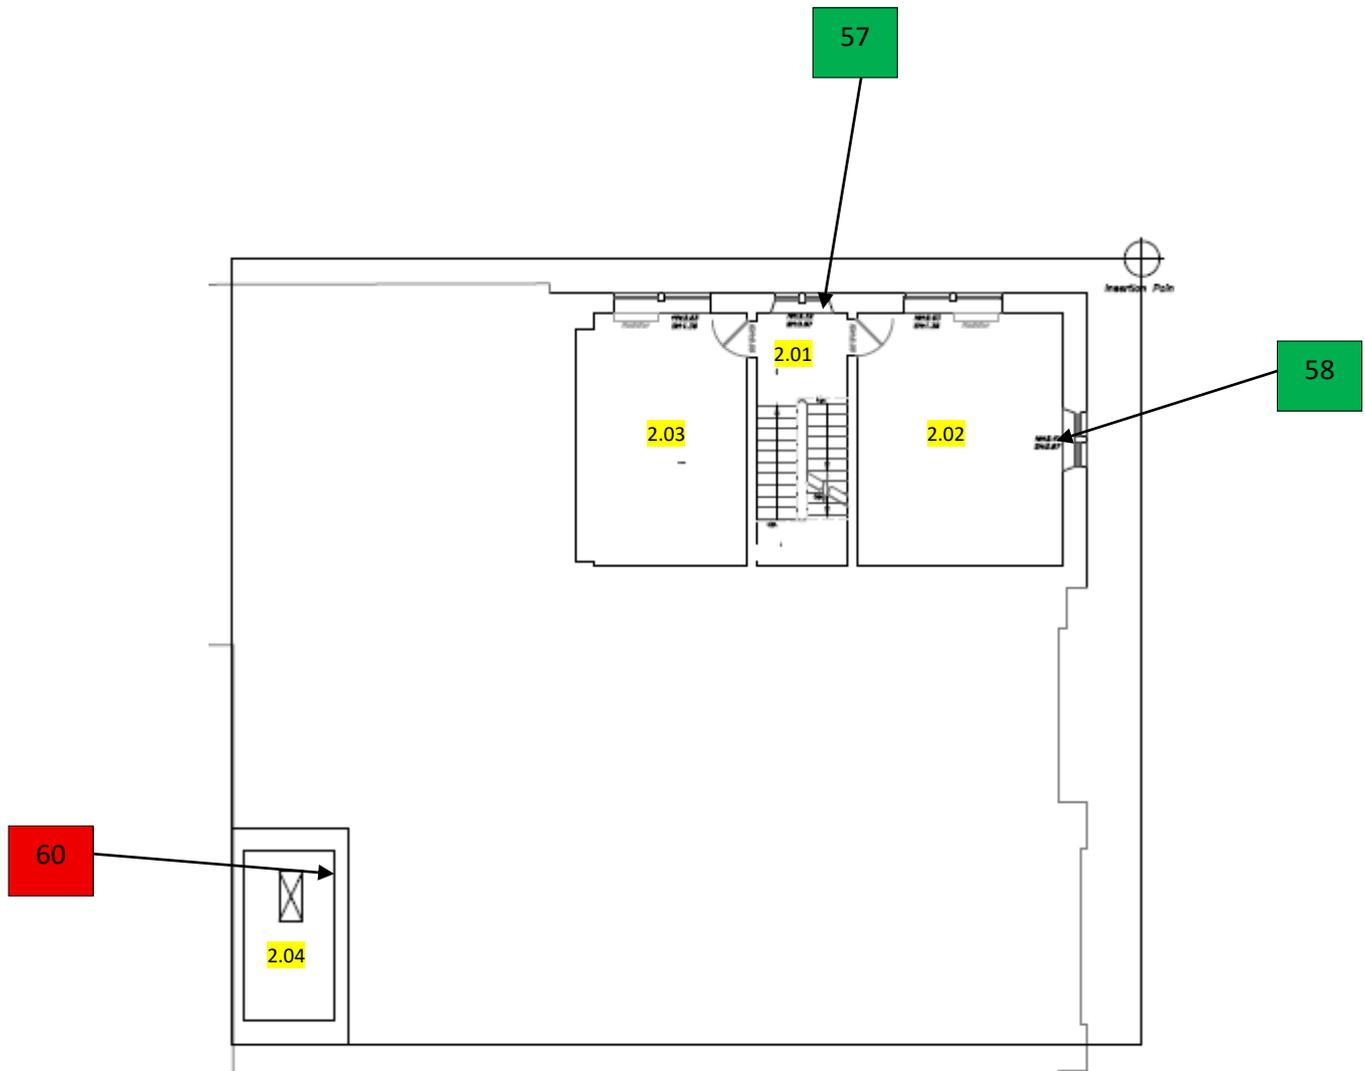

#### GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)

ILLUSTRATION ONLY – NOT TO SCALE


F74 Issue 5 21.02.2024

## FLOOR PLAN

**ADDRESS:** Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

**JOB NO:** J12946    **DATE:** 18.11.25 to 07.12.25    **SURVEY TYPE:** Management Survey

### THIRD FLOOR

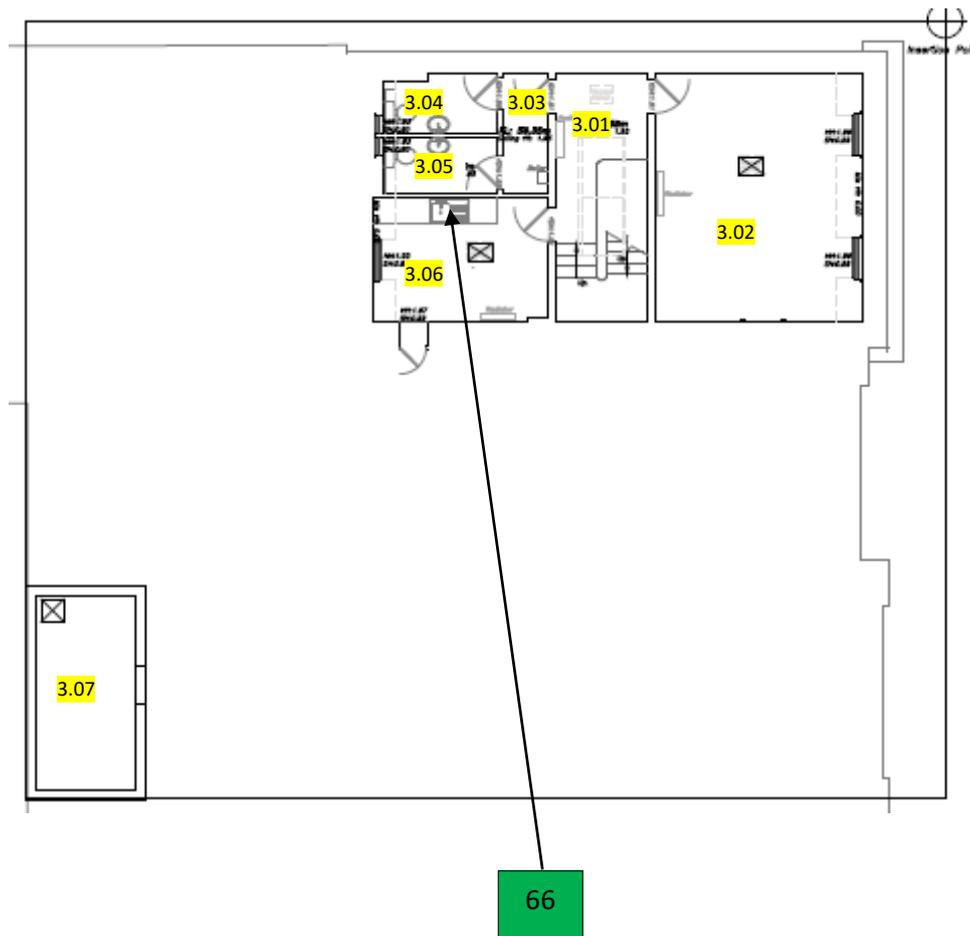

#### GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)

ILLUSTRATION ONLY – NOT TO SCALE


F74 Issue 5 21.02.2024

# FLOOR PLAN

ADDRESS: Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

JOB NO: J12946    DATE: 18.11.25 to 07.12.25    SURVEY TYPE: Management Survey

## ATTICS

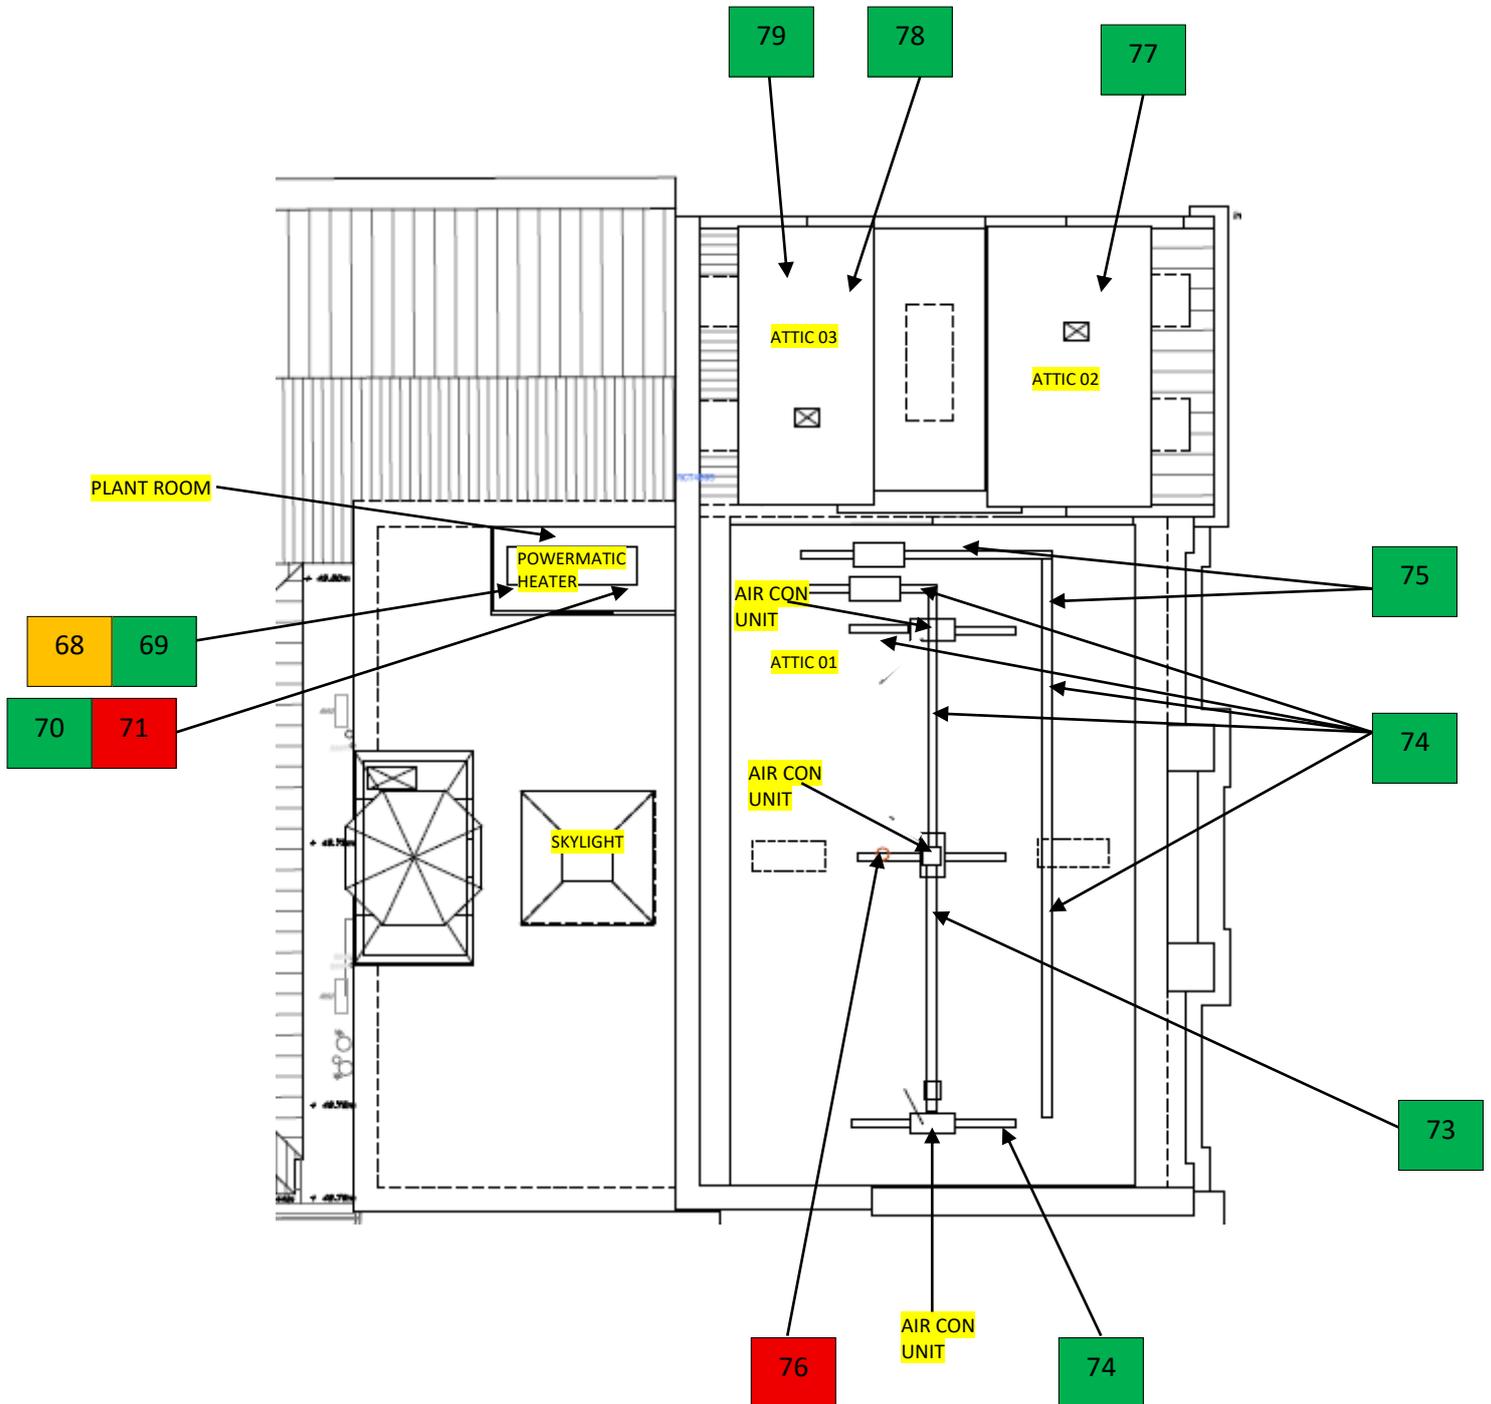

### GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)


ILLUSTRATION ONLY – NOT TO SCALE

F74 Issue 5 21.02.2024

# FLOOR PLAN

**ADDRESS:** Chippenham Town Hall, High Street, Chippenham, Wiltshire, SN15 3ER

**JOB NO:** J12946    **DATE:** 18.11.25 to 07.12.25    **SURVEY TYPE:** Management Survey

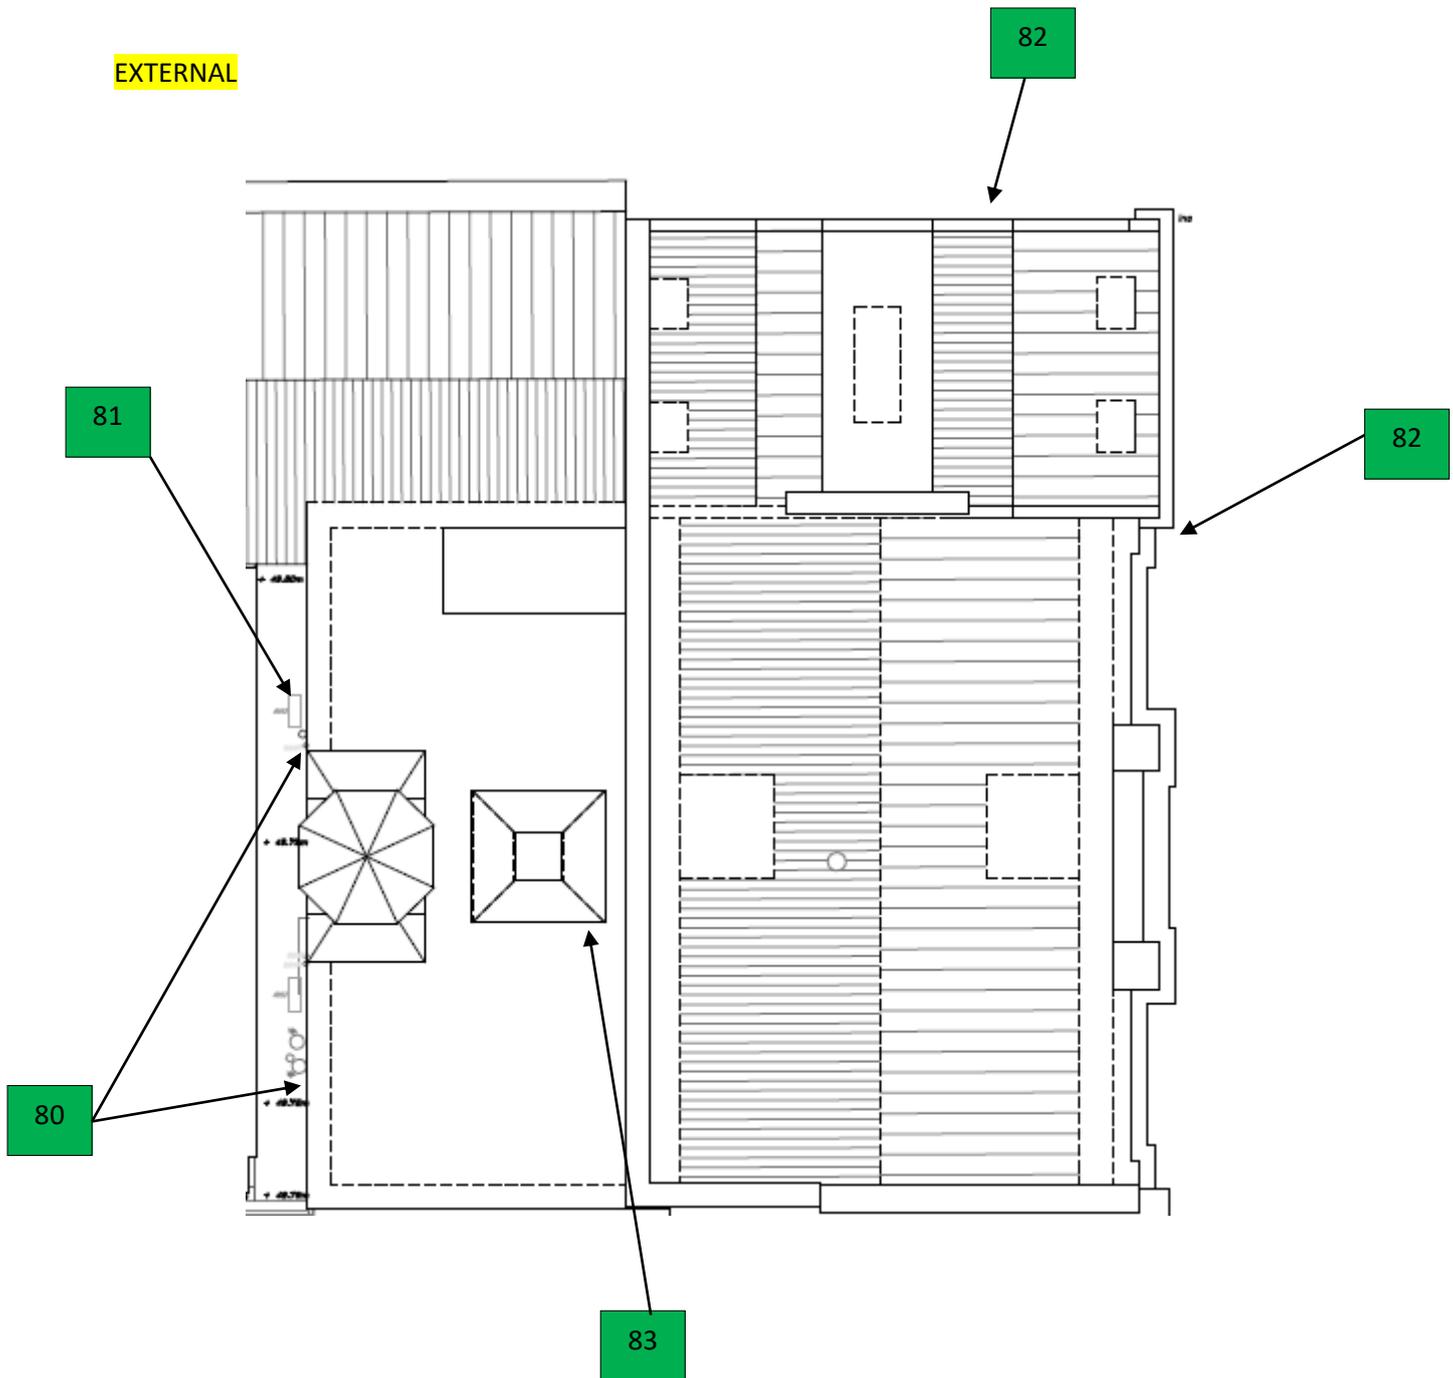

## GUIDANCE NOTES:

Red = Asbestos Containing Material, Green = Non Asbestos Containing Material, Orange = Presumed Asbestos Containing Material/No Access, Black = Removed

Highlighted Text = Area/Room Number, Box Numbers = Report Inspection Numbers (see main Report)

ILLUSTRATION ONLY – NOT TO SCALE

F74 Issue 5 21.02.2024