

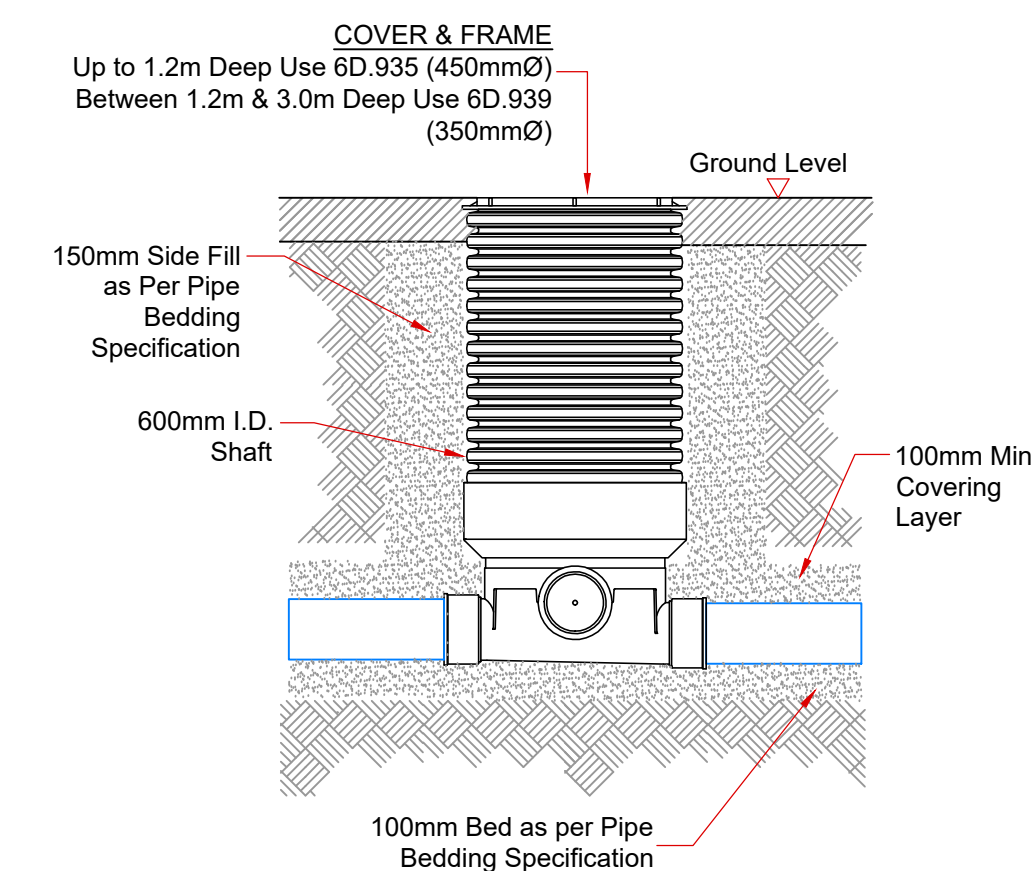
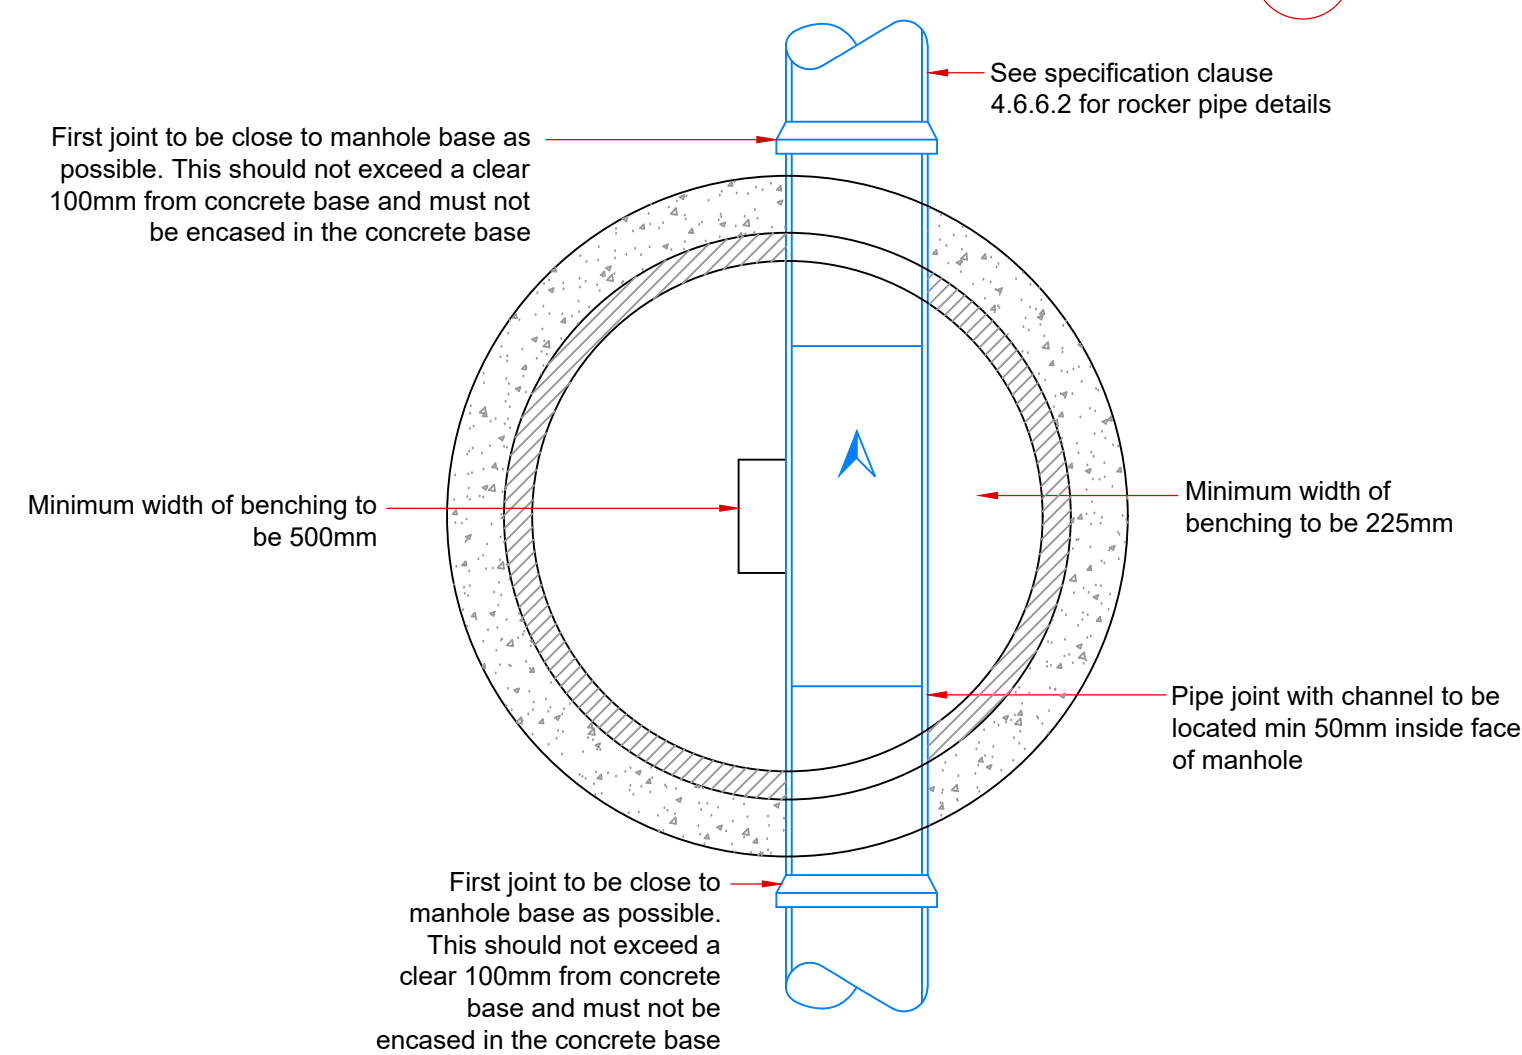
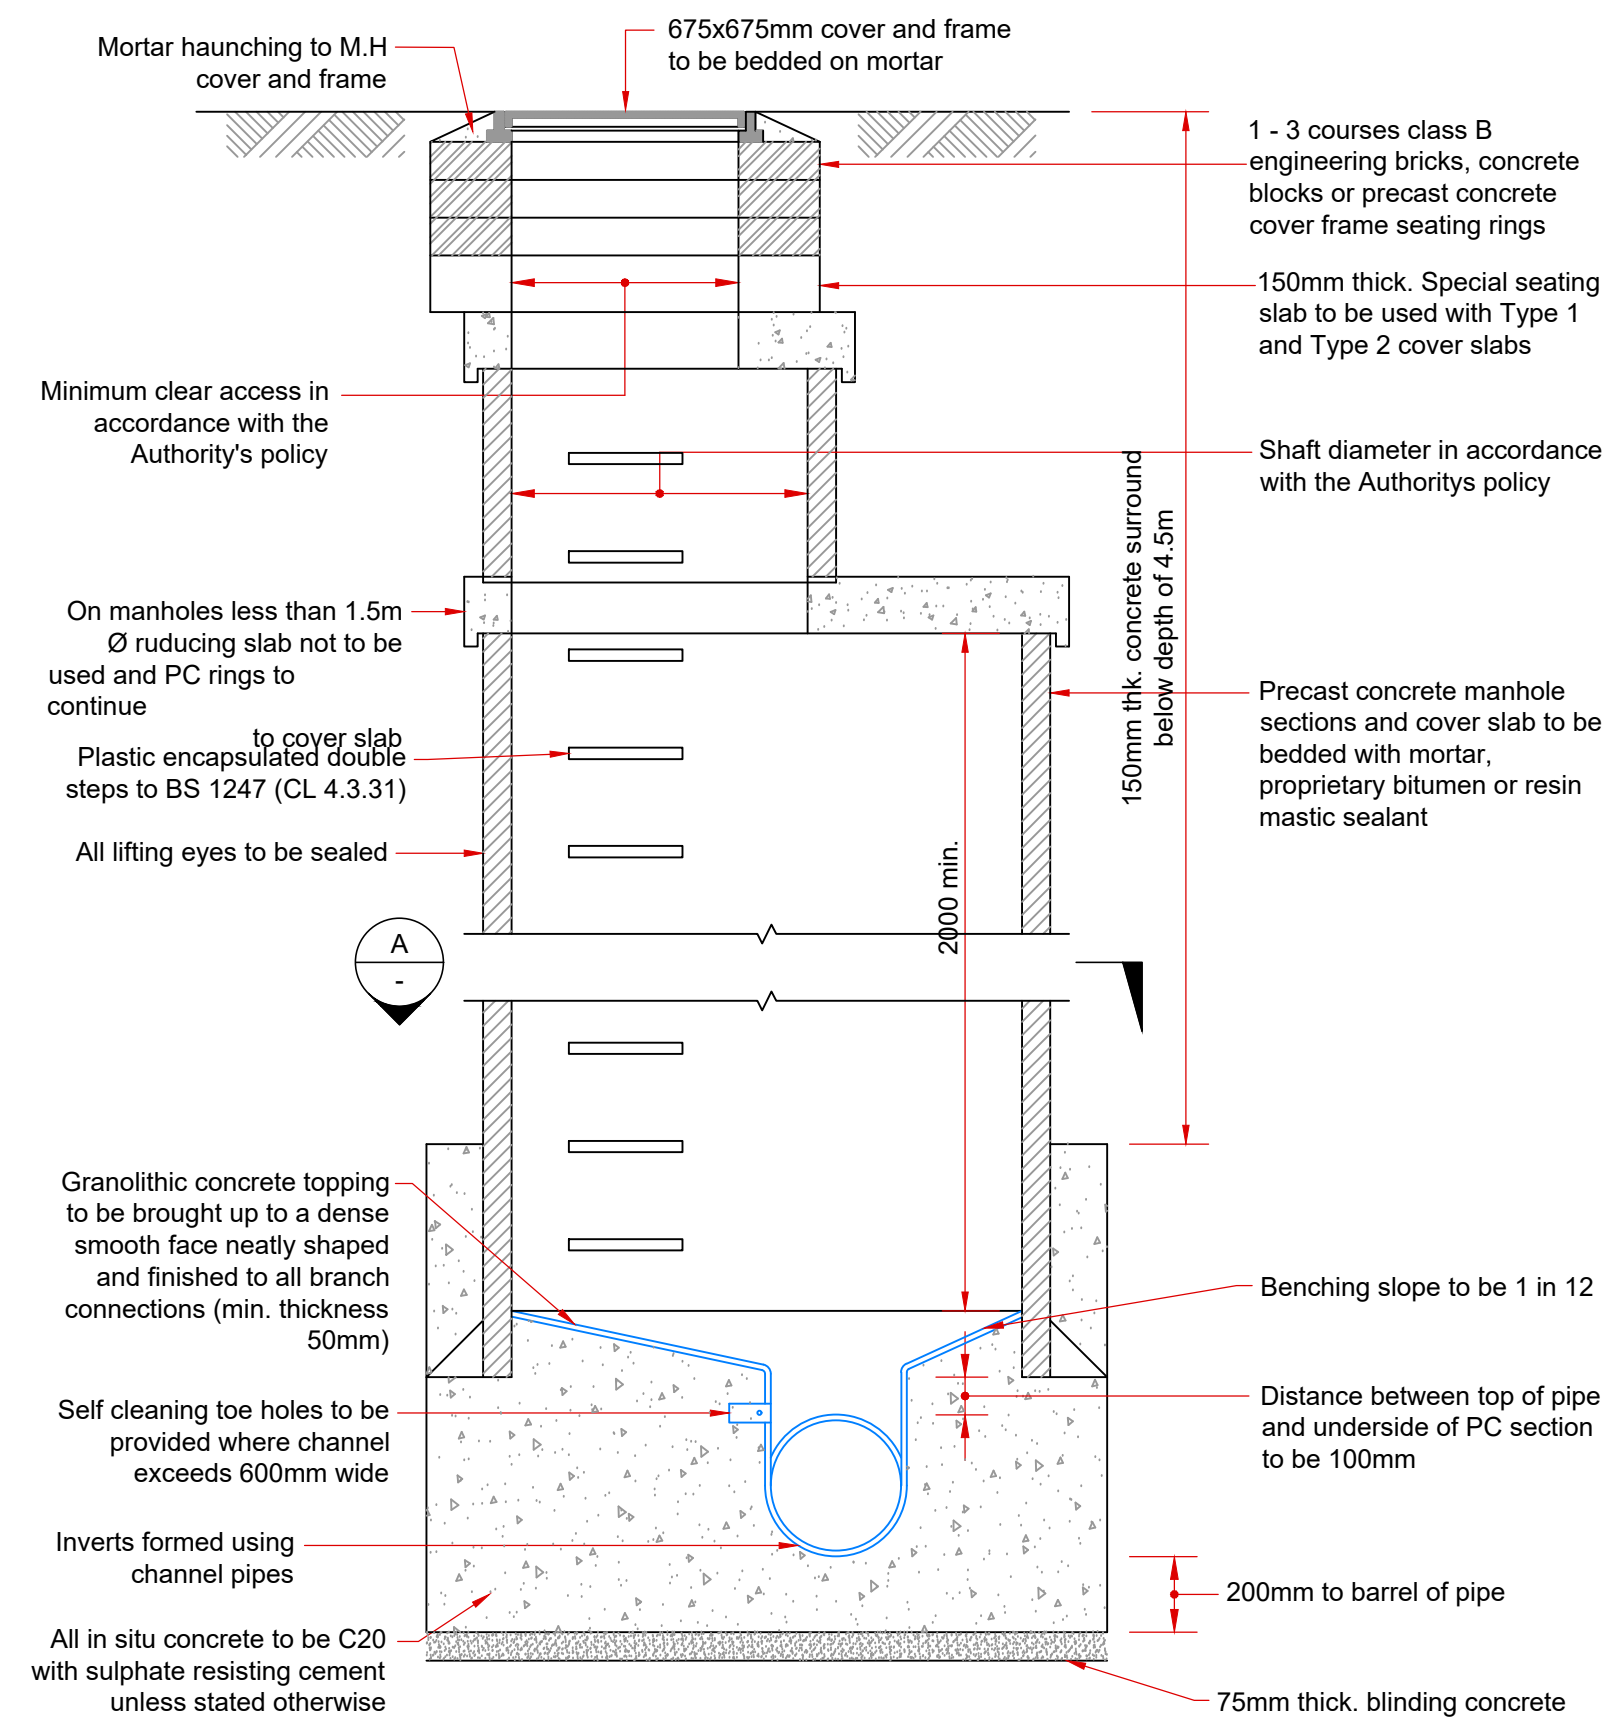
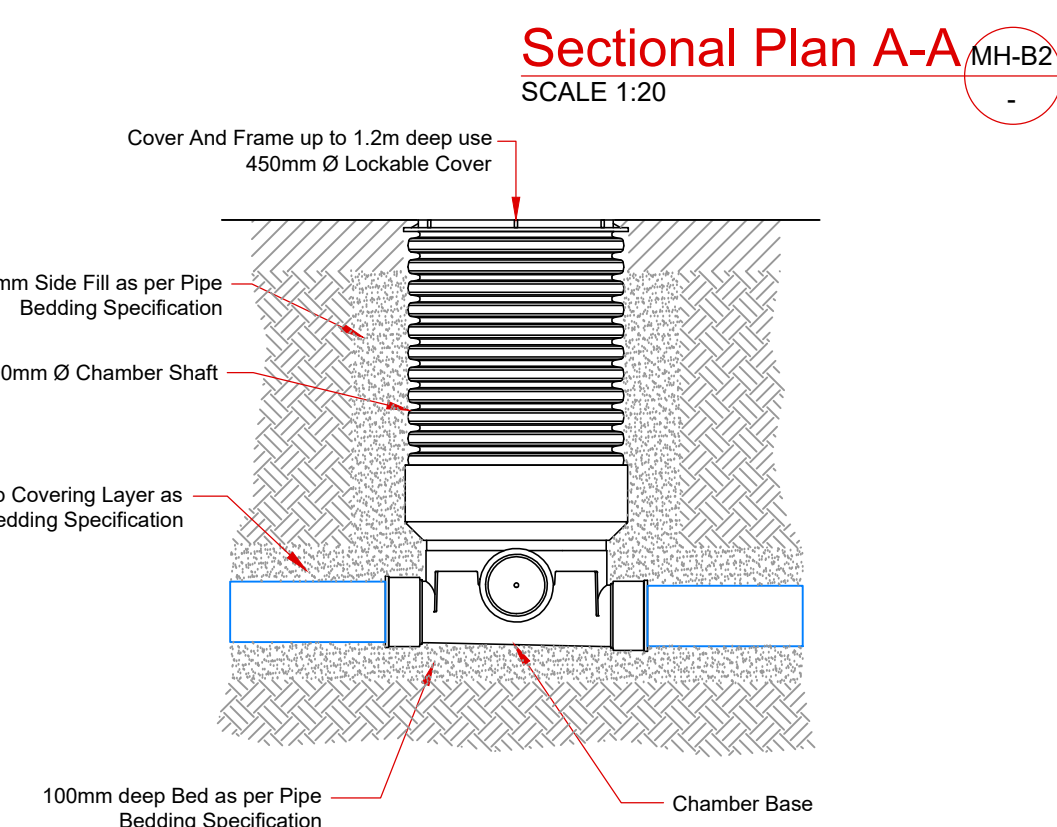
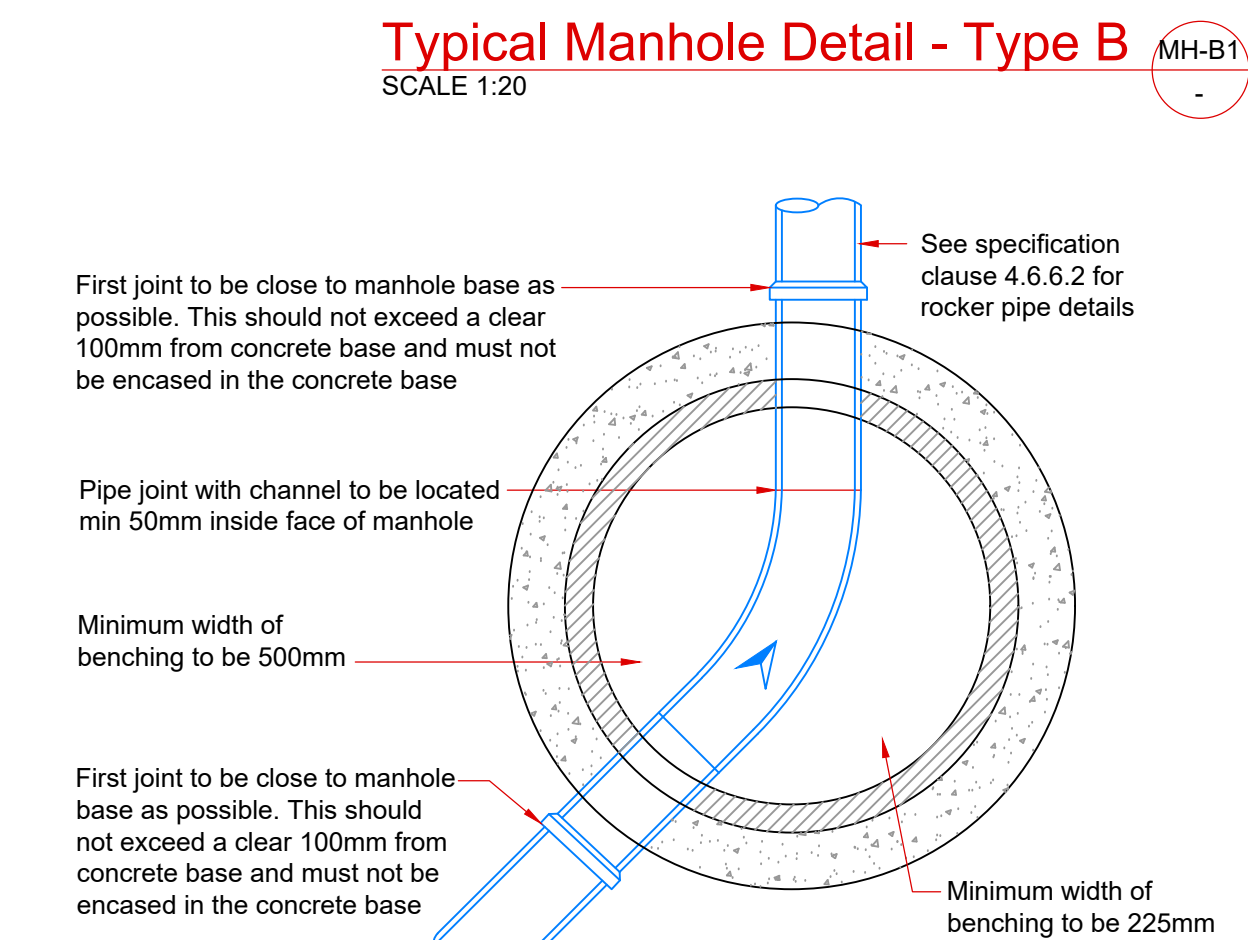


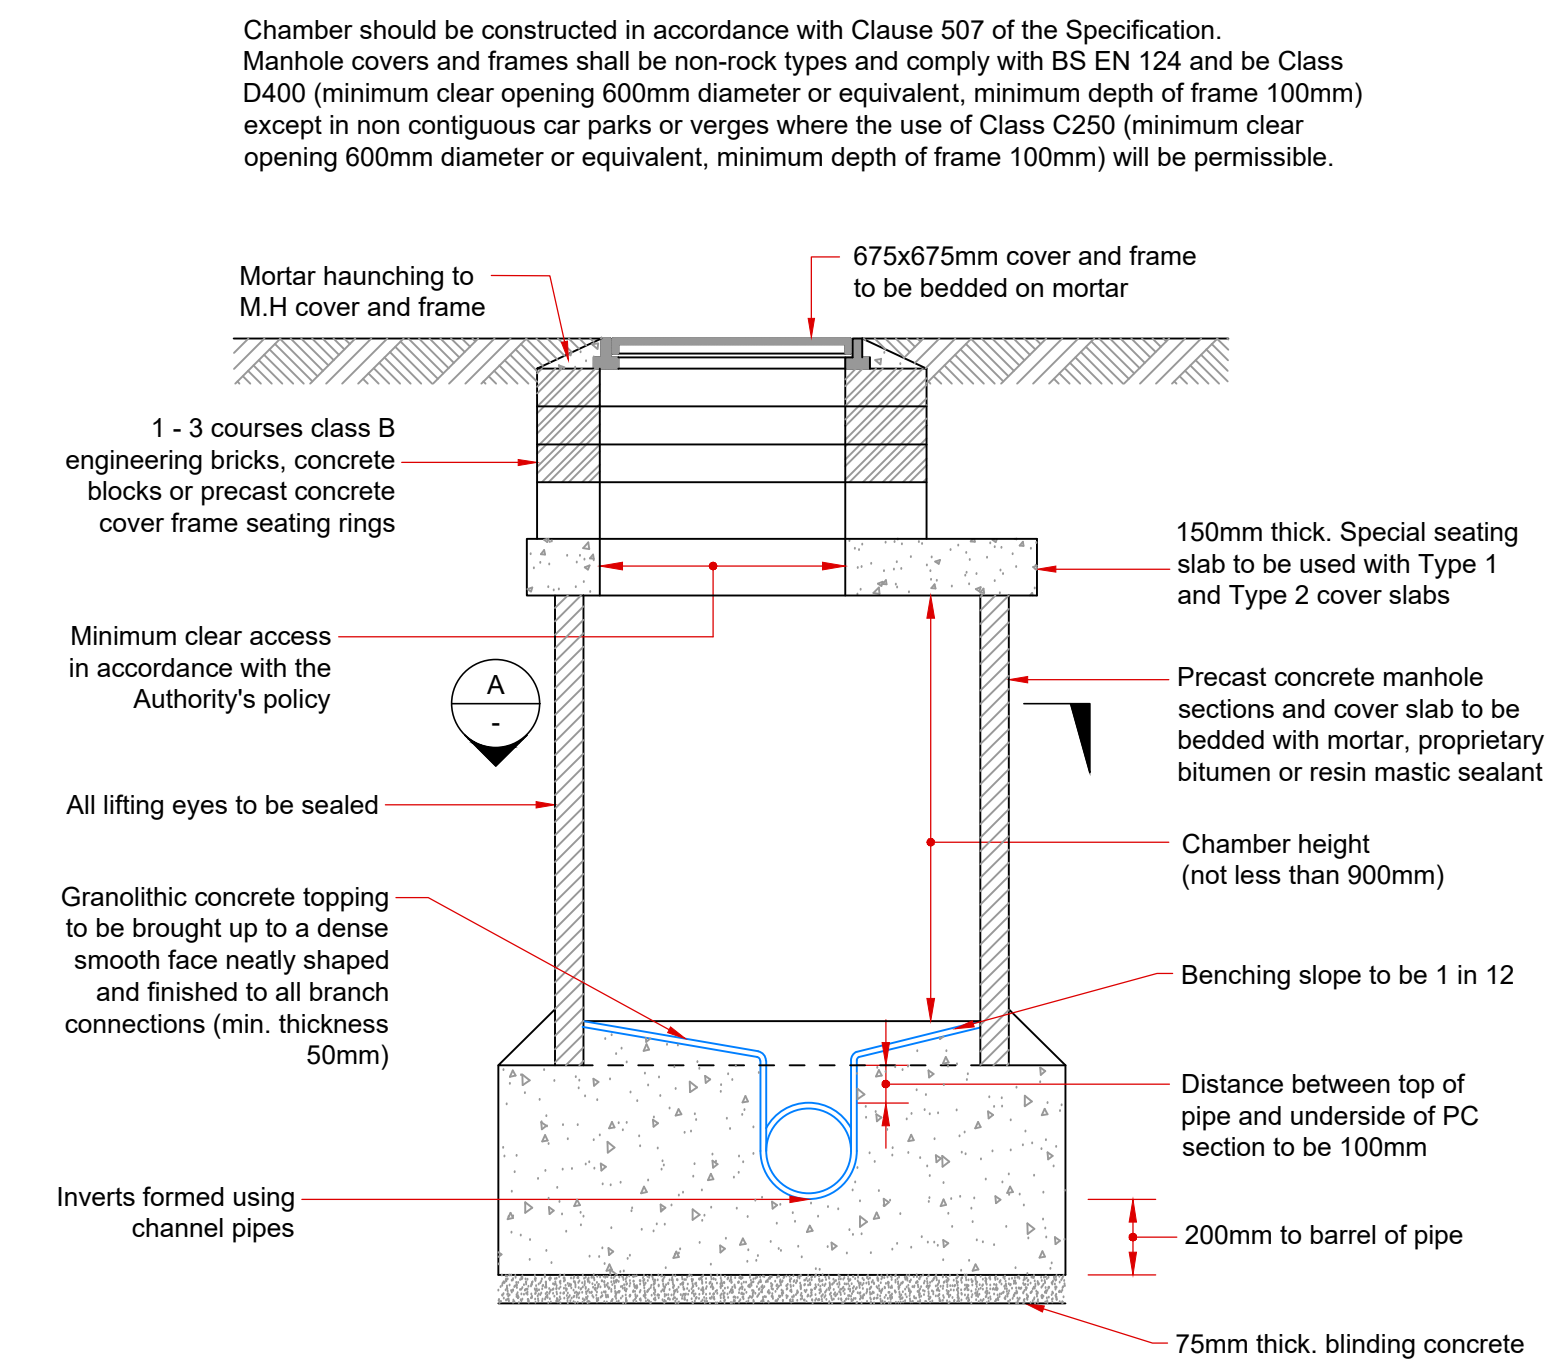


Typical Section Through Non-Entry Disconnection Chamber (CP1) (Suitable for Depth of up to 3 Meters) SCALE 1:20


Pipe Bedding Detail (PVC & VC) (CP1) SCALE 1:20

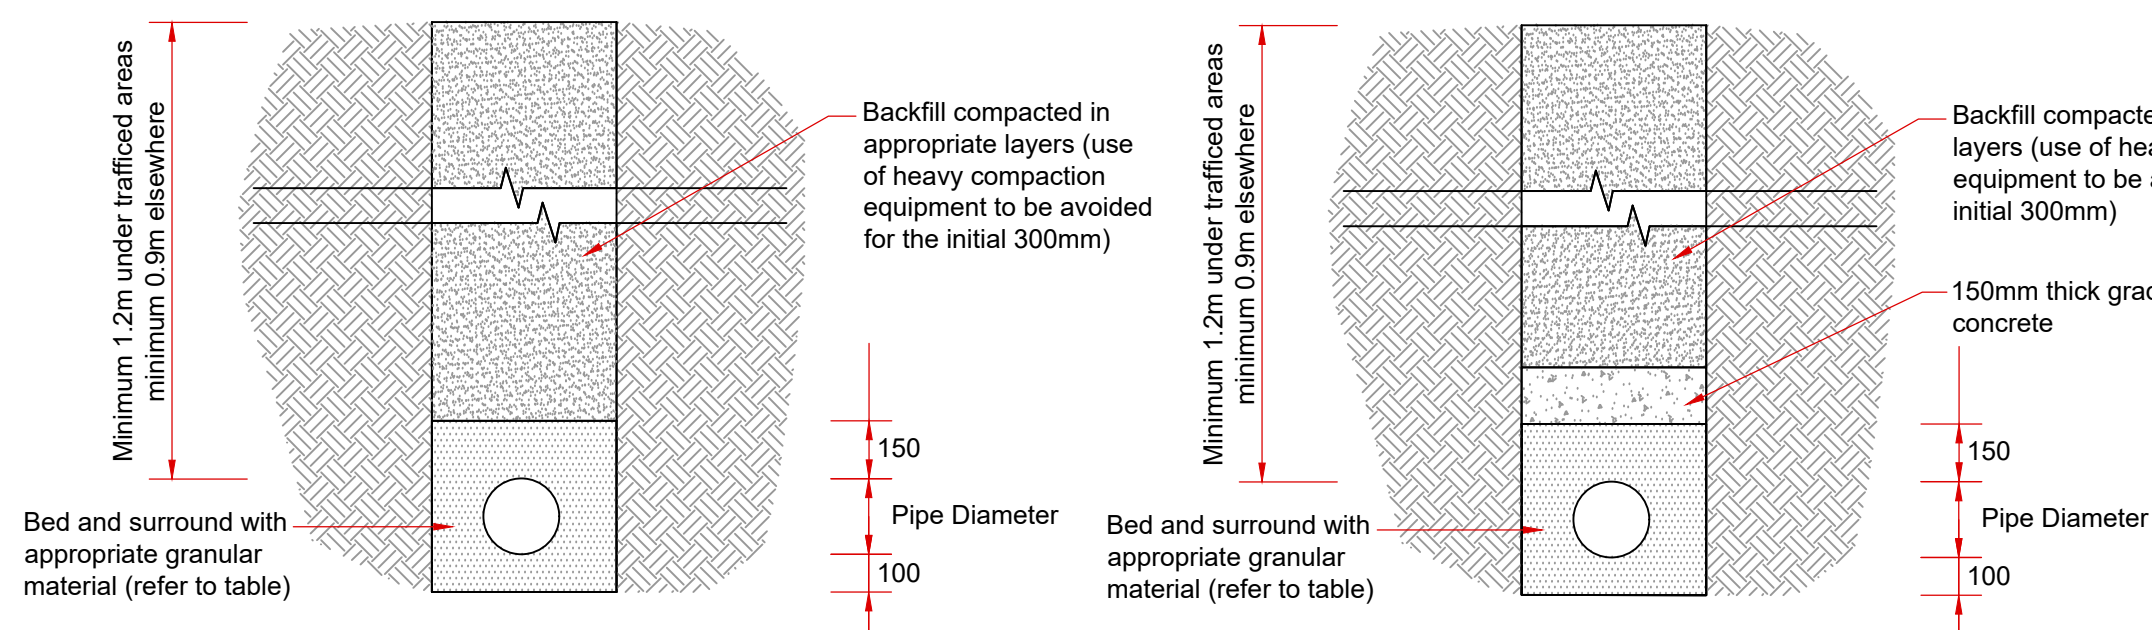

Typical Section Through Shallow Inspection Chamber (IC(S)) (Depth to Invert 1.2m) SCALE 1:20

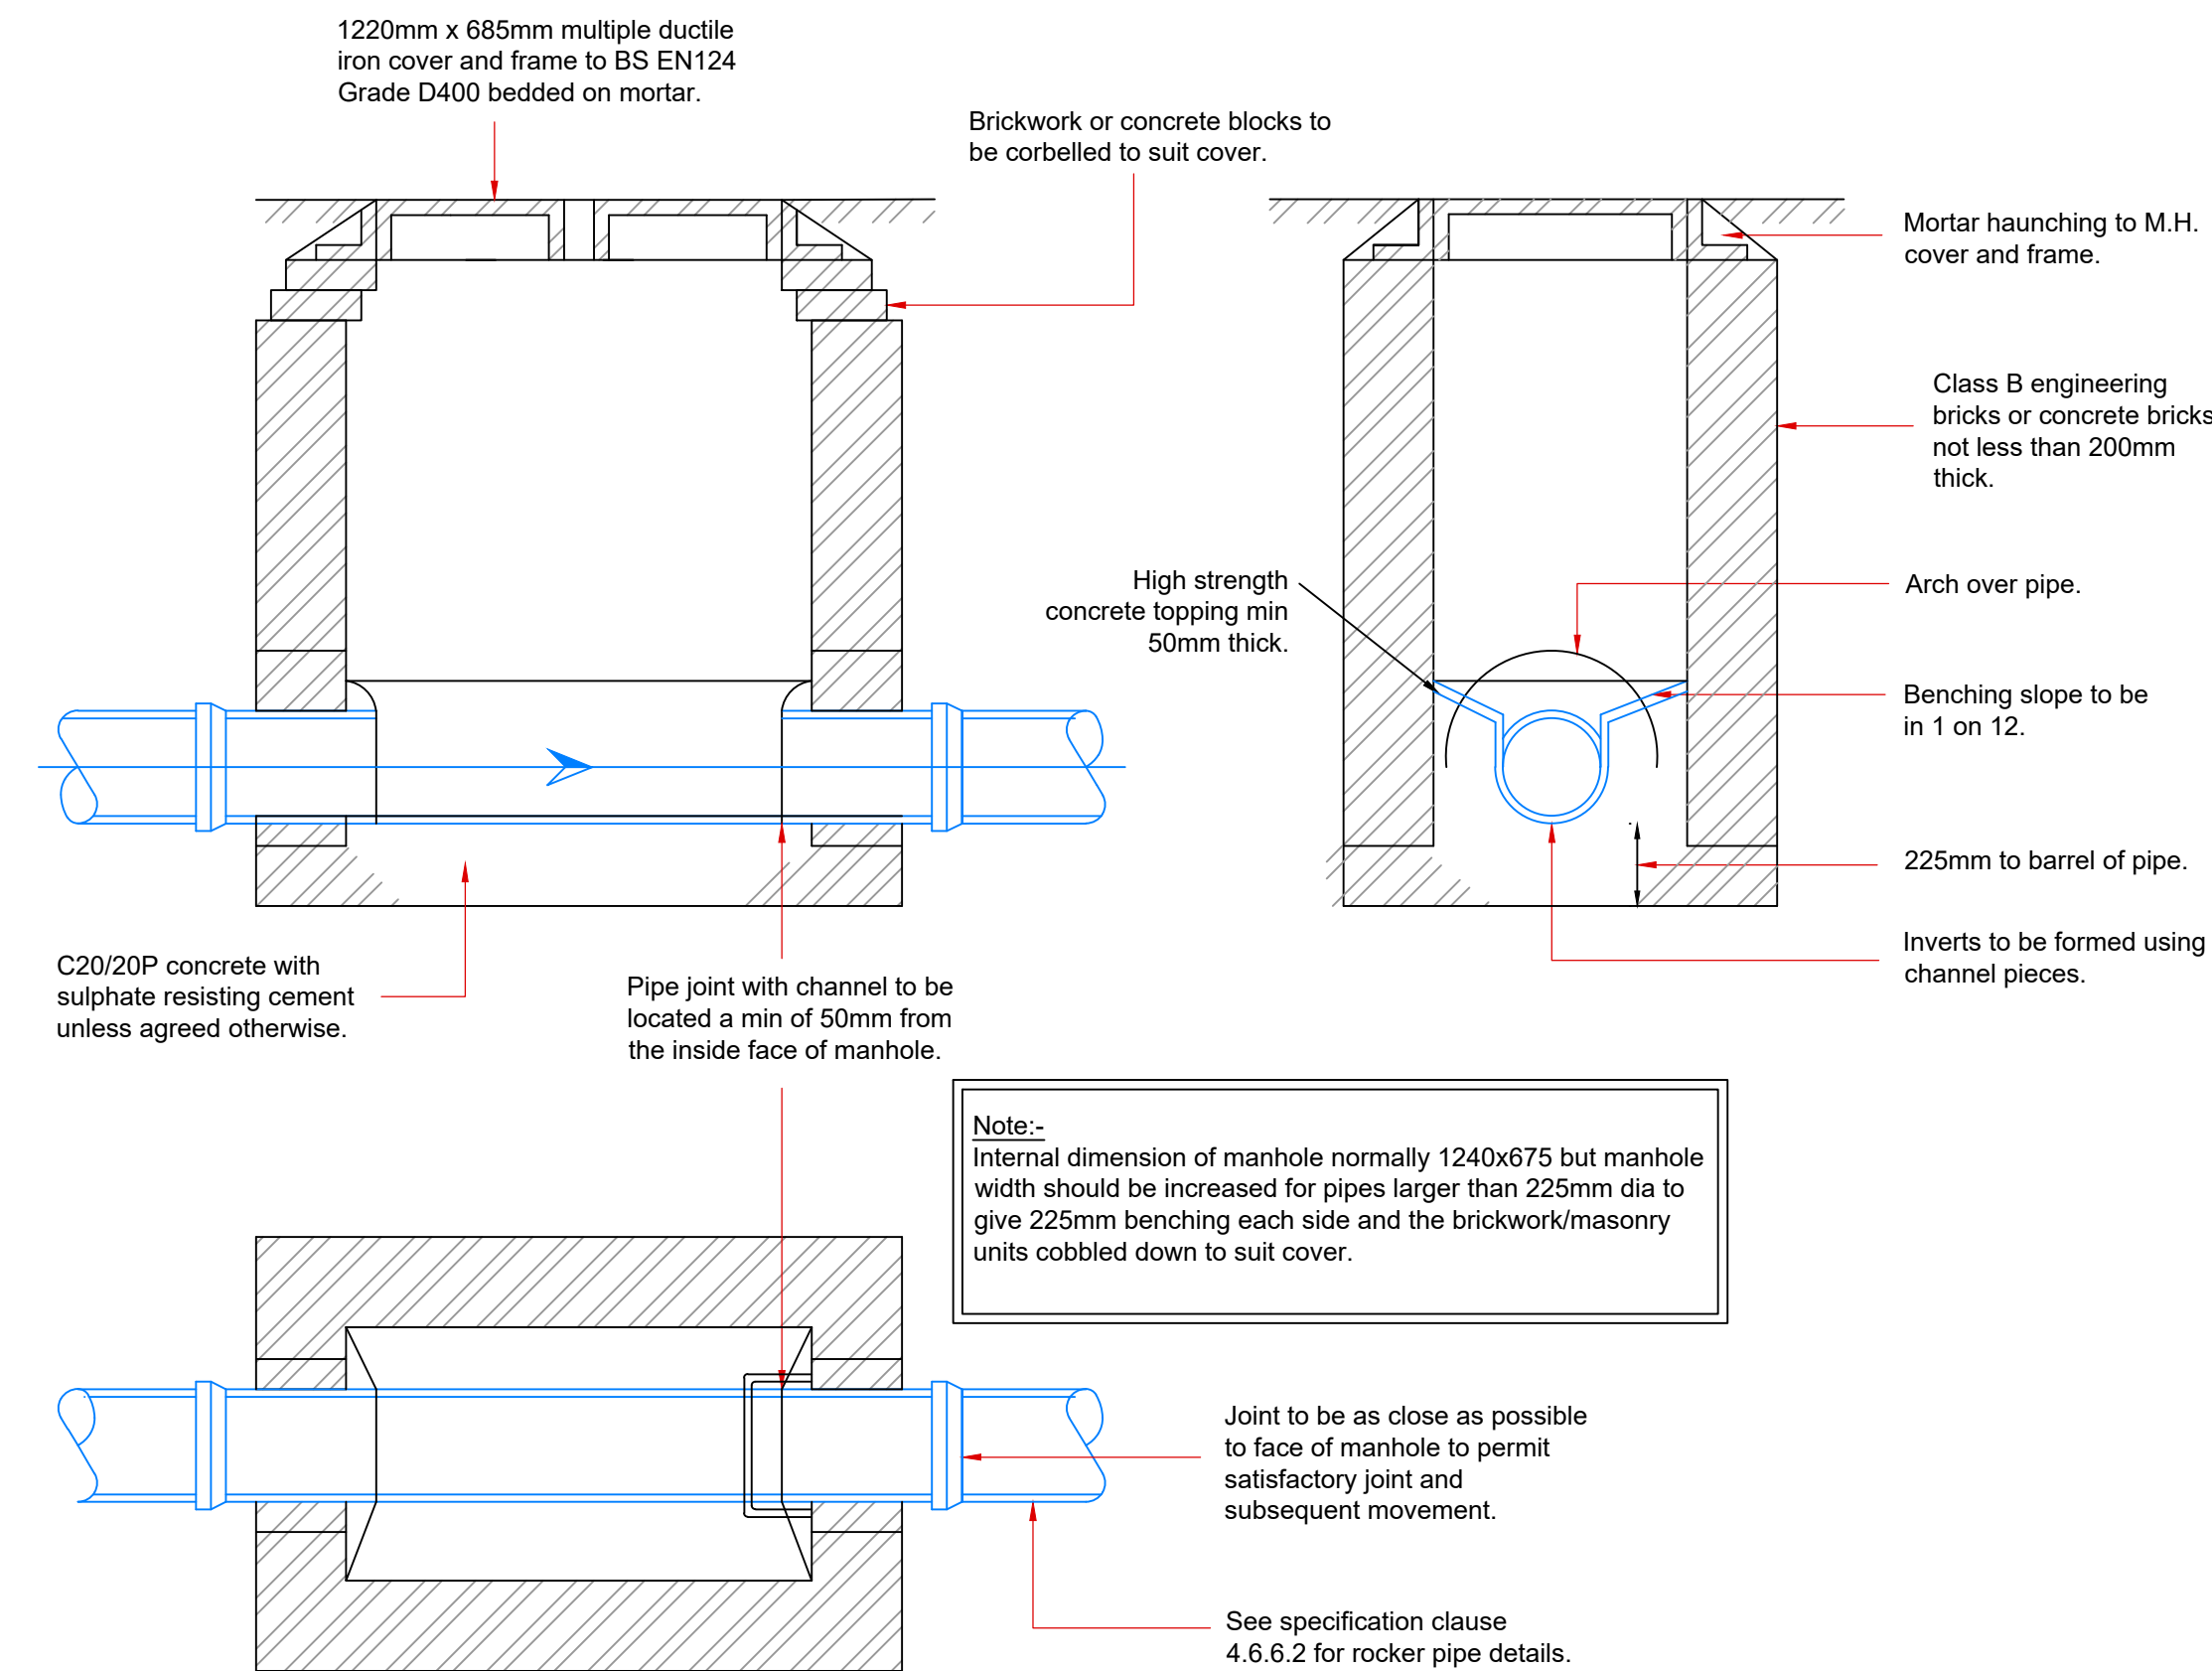

Typical Manhole Detail - Type C (MH-C1) (DEPTH FROM COVER LEVEL TO SOFFIT OF PIPE 1.0M-1.5M) SCALE 1:20

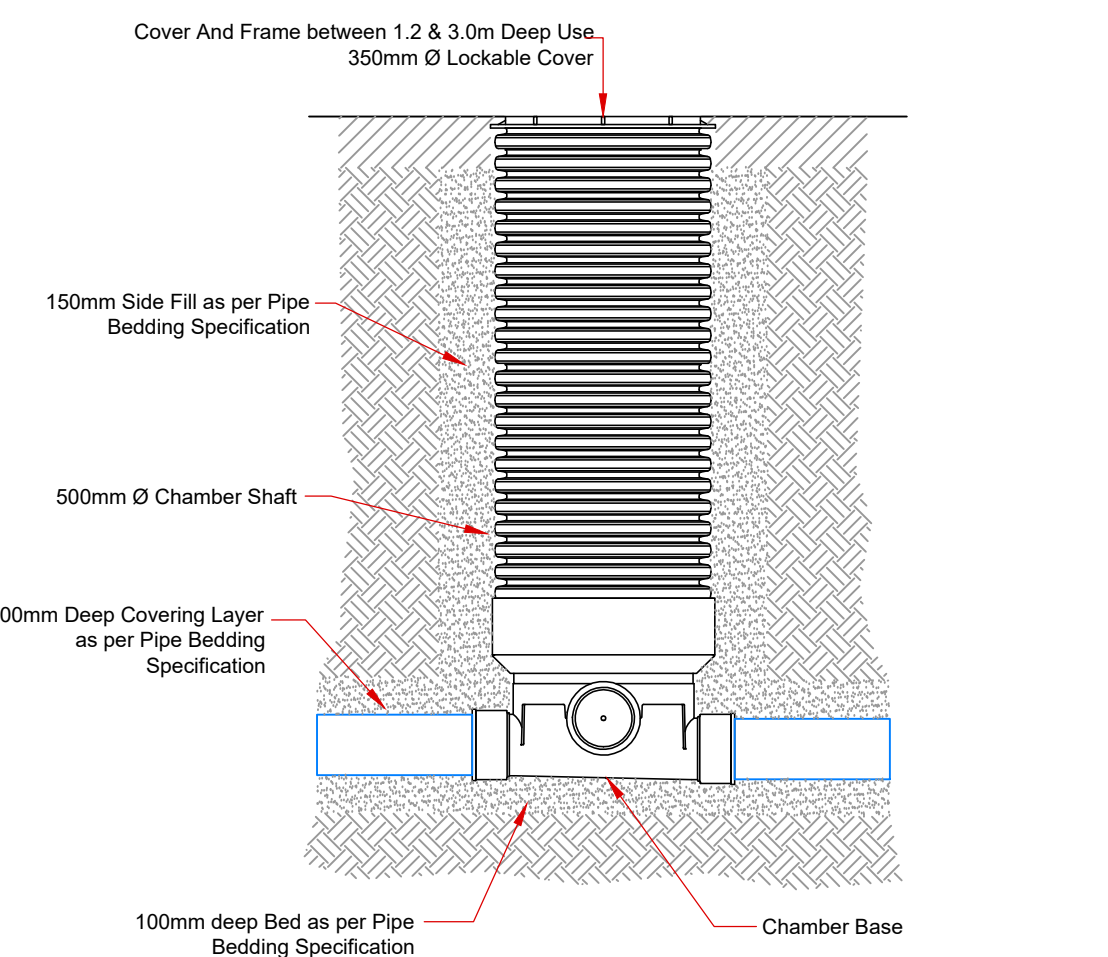

Typical Section Through Deep Inspection Chamber (IC(D)) (Depth to Invert 1.2-3.0m) SCALE 1:20

NOTE:
All mains and service pipe installations will require a degree of over excavation. Trenches should be double width and backfilled with clean, imported, inert material to a minimum of 1.3m deep and 0.8m wide.

Nominal Pipe Size	Granular Material Size
150mm	10 or 14mm nominal single size or 14 to 5mm course graded
225mm and over	10, 14 OR 20mm nominal size or 14 or 20 to 5mm course graded

Granular Bedding Material Table (SCALE 1:20)

A	Amended Status	MJA	15/09/2025
Issue	Revision	Initial	Date

Cameron + Ross
CIVIL + STRUCTURAL ENGINEERING

Forbes House | 15 Victoria Street | Aberdeen | AB10 1XB
t: 01224 642 400 | w: cameronross.co.uk
Mulberry House | 39-41 Harbour Road | Inverness | IV1 1UF
t: 01463 570 100 | w: cameronross.co.uk

Client:
Energy Transition Zone

Project:
Mooring Facility
Hareness Road
Aberdeen

Drawing Title:
Drainage Construction Details

Status:
WARRANT

Scale: As Shown @ A1 Date: 02/06/2025
By: MJA Checked: AAM Approved: GGC

Dwg. No. 221193-000-CAM-DR-C-460 Rev. -