


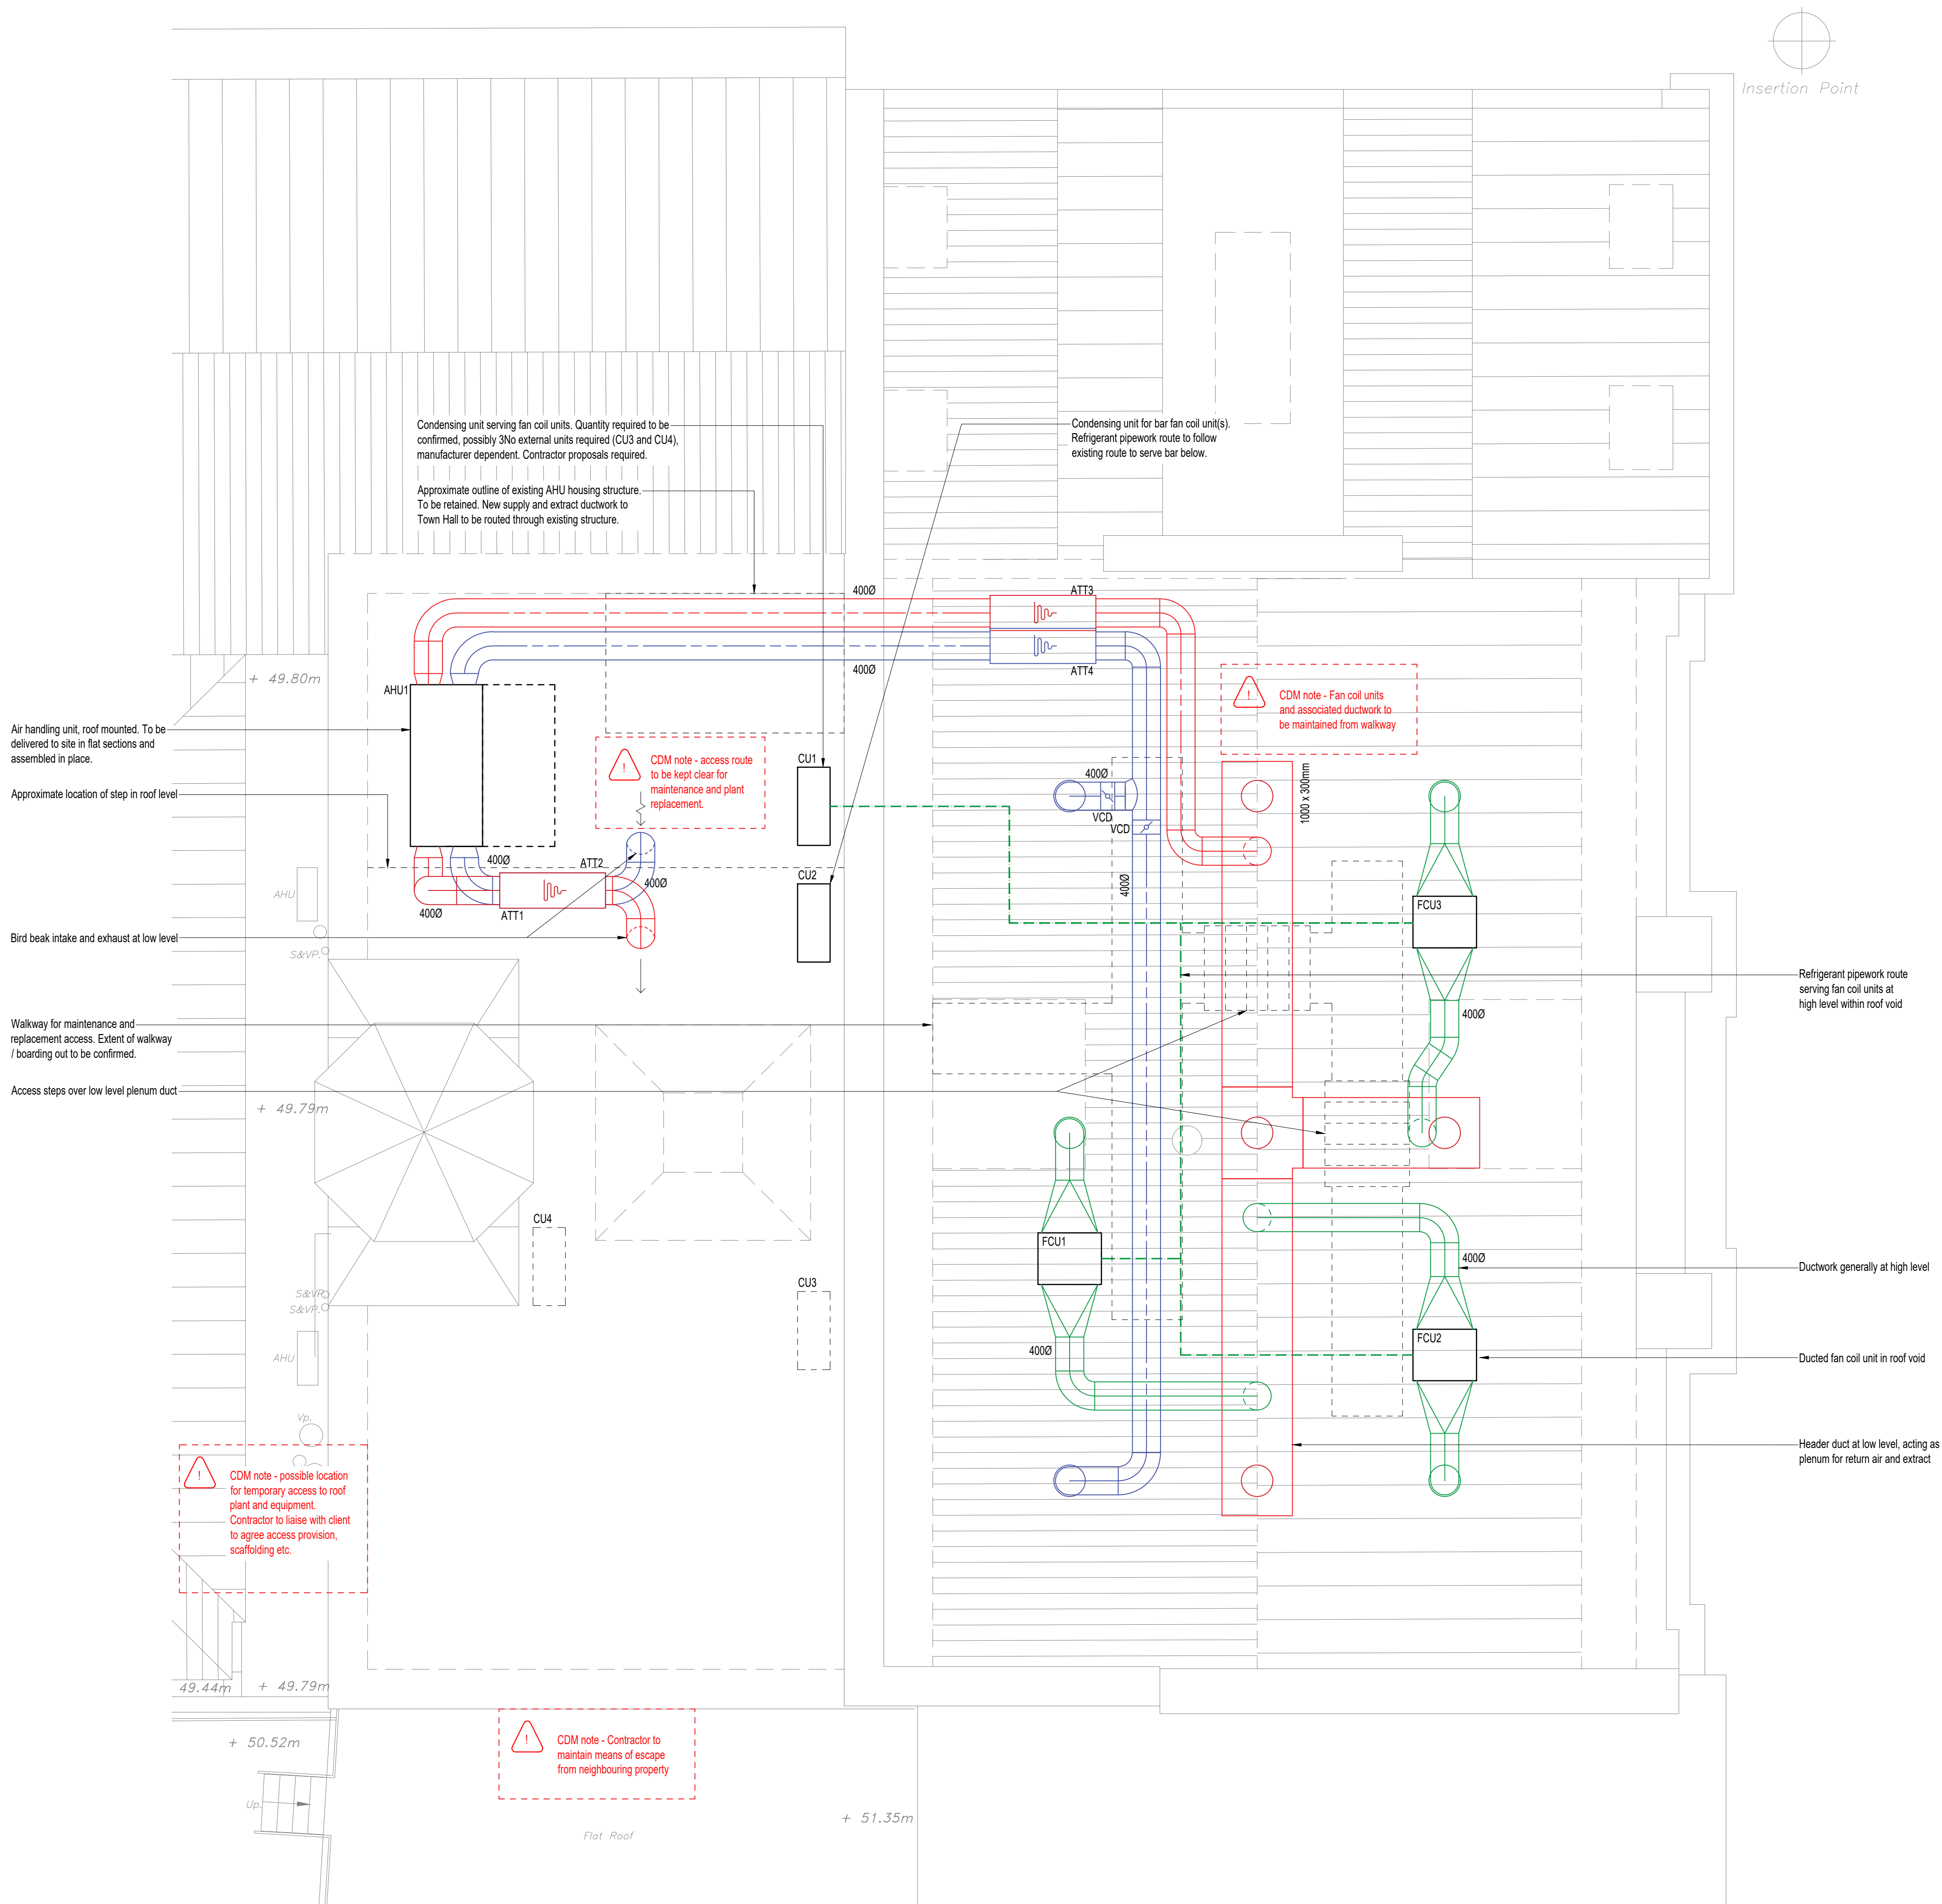

Do not scale from this drawing.
All dimensions to be confirmed on site.

- Notes
- Drawings to be read in conjunction with the schematic drawings and specification.
 - Condensate drainage to be provided to match existing strategy.

CDM Note - Contractor to note the existing roof void does not have a safe surface for access. Contractor to propose method for safe access to remove existing plant and ductwork and install, commission, maintain new plant and ductwork.

- Key
- EL Exhaust air terminal
 - SL Supply (intake) air terminal
 - Extract/return system
 - Ventilation supply system
 - Fan coil unit system
 - ATT Attenuator
 - AHU Air handling unit
 - FCU Fan coil unit
 - CU Condensing unit
 - VCD Volume control damper

T02	25 Nov 25	Revised Tender Issue
T01	14 Nov 25	Tender Issue
P02	30 Oct 25	Draft Tender Issue
P01	16 Apr 25	Preliminary Issue

Revisions

Client Internal Project No. 4887

Chippenham Town Council

Architect

N/A

e3
consulting engineers

Queen Square House, 18-21 Queen Square, Bristol, BS14NH
TEL: 0117 238 0909 www.e3ce.com

Project

Chippenham Town Hall

Title

Town Hall Roof
Proposed Mechanical Drawing

Drawing No.

CTH-E3CE-TH-R0-D-M-9010

Scale	Author	Reviewer	Status	Rev.
1:50 @ A1	IB	HG	-	T02